
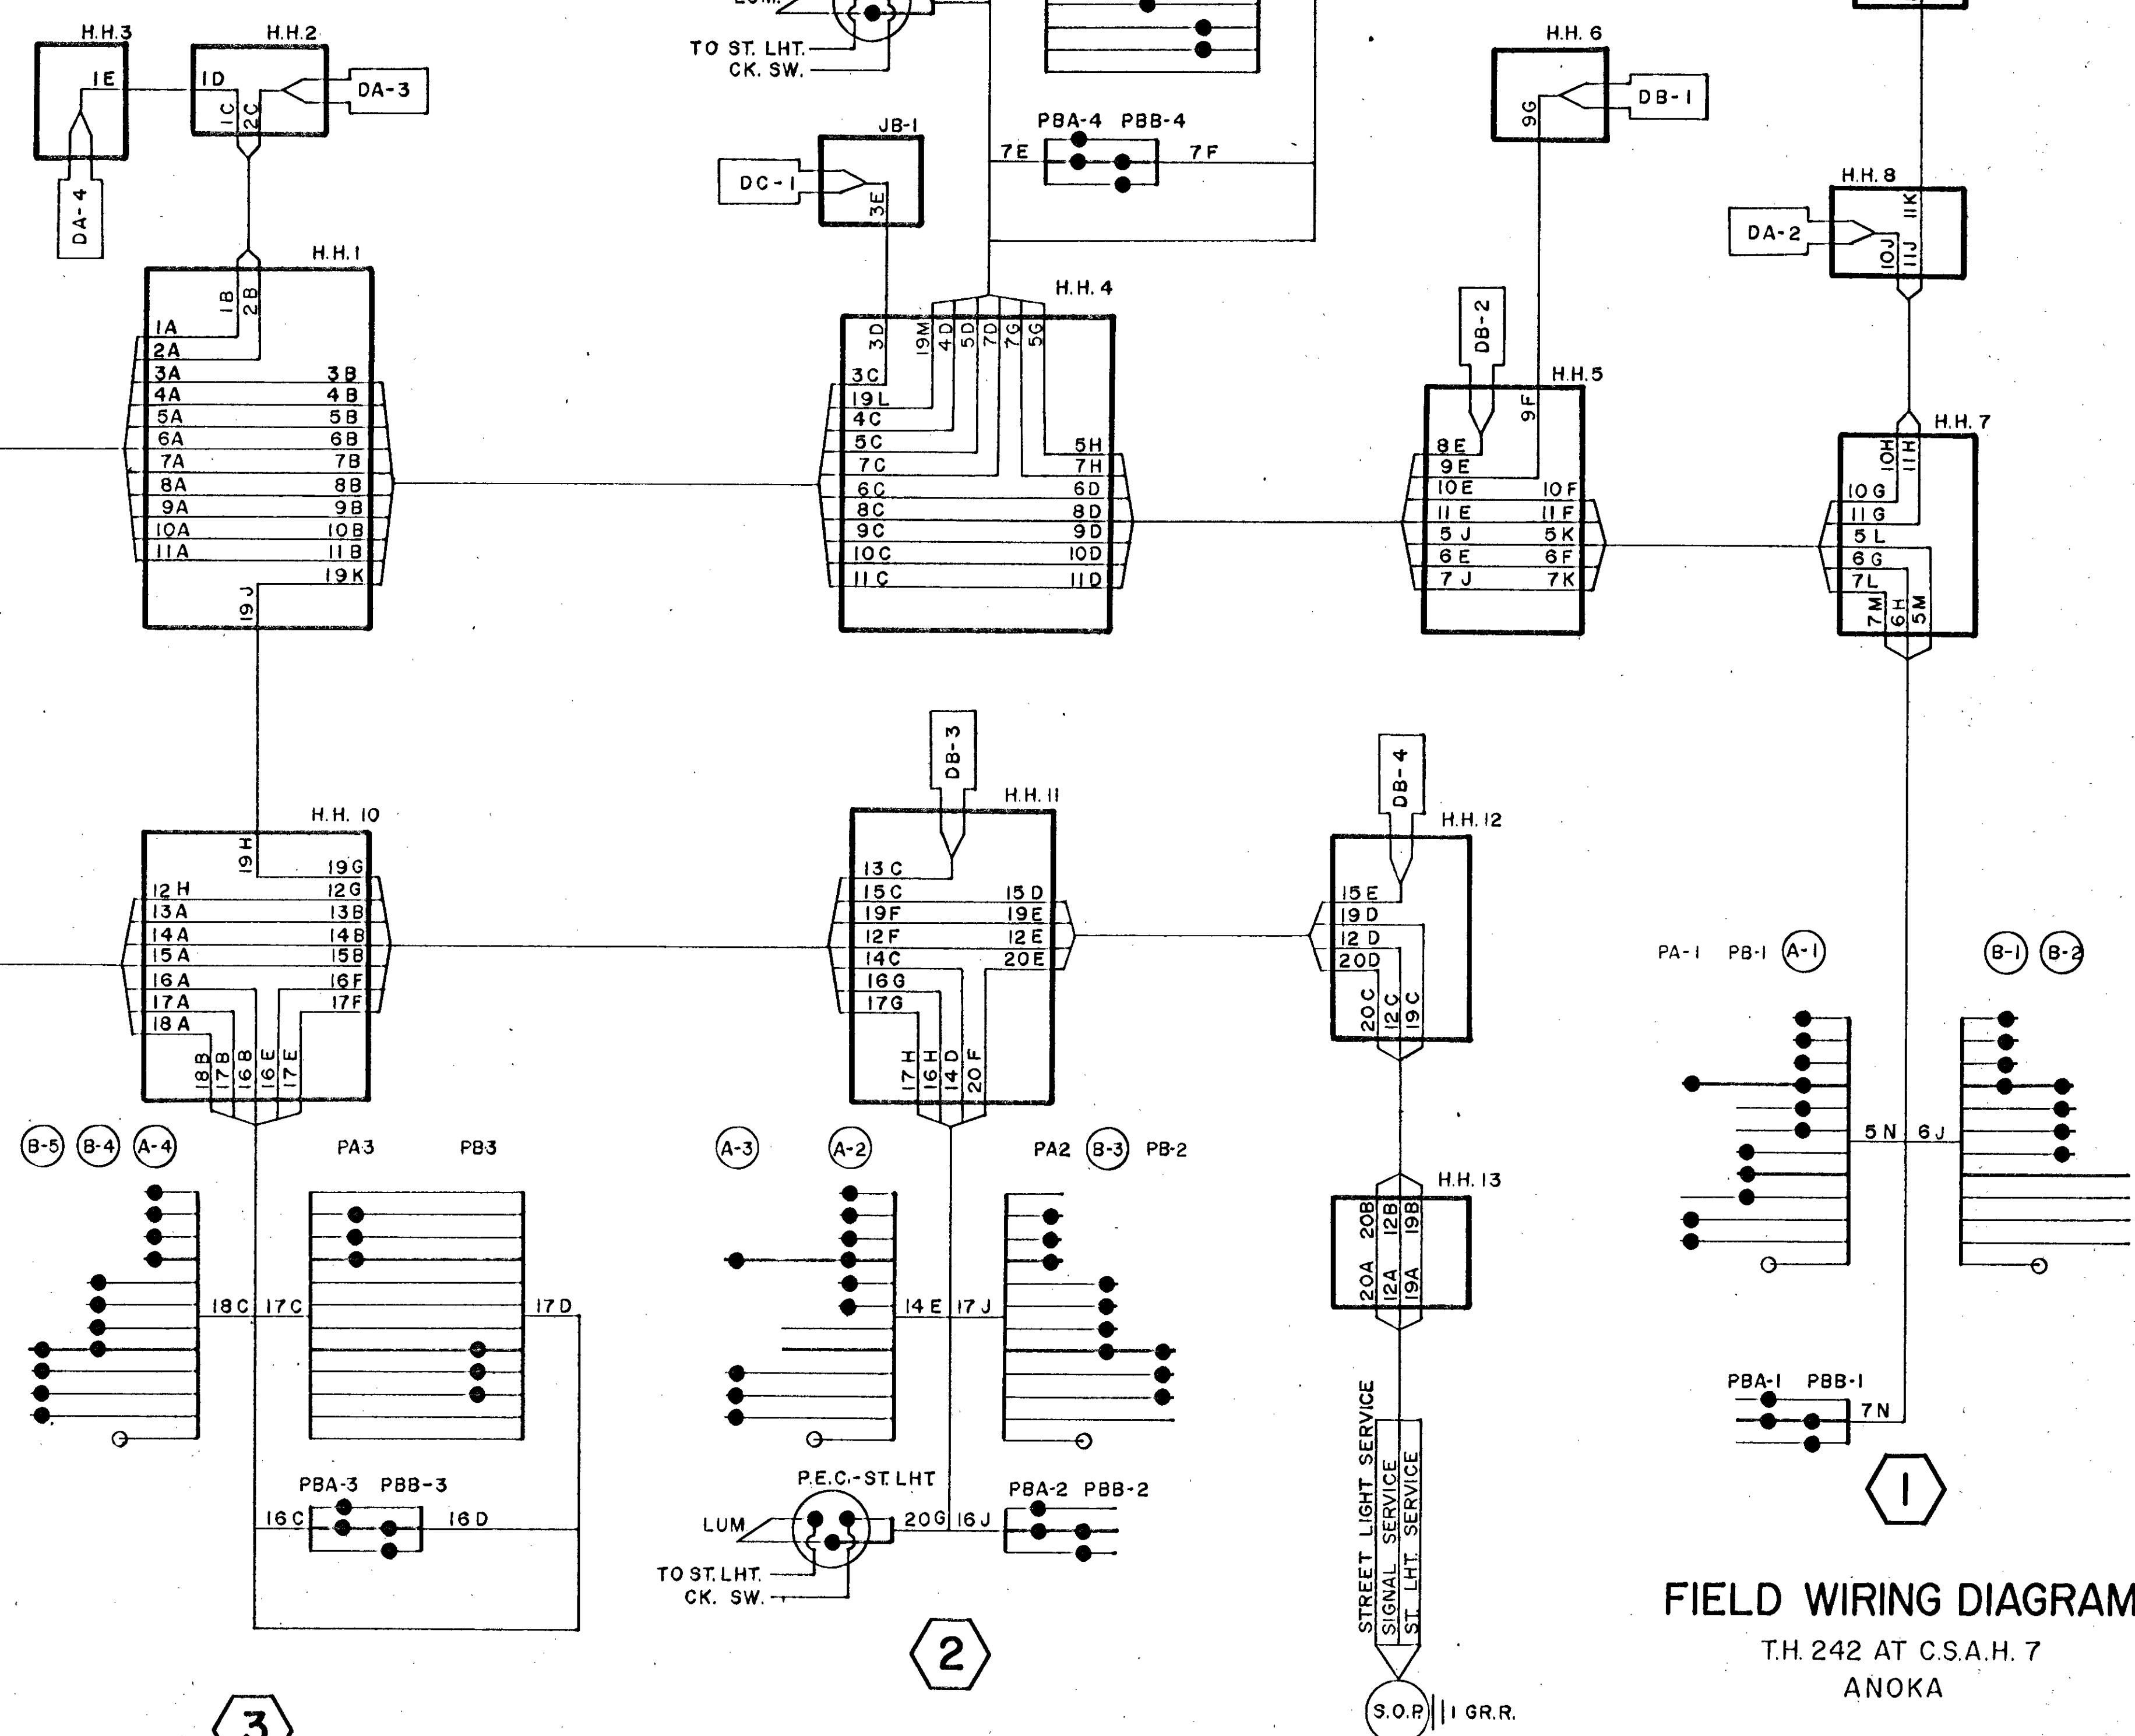


TYPICAL CONDUCTOR COLOR CODE

R	BLK
O	WH
BL	R
WH	CLR
R/BLK	BLK
O/BLK	SHI. BR. GRD. CABLE
BL/BLK	BLK
WH/BLK	WH
BLK	BLK
BLK/WH	WH
G/BLK	R
G	WH

NOTE: ALL TERMINAL BLOCK CONNECTIONS SHALL BE ARRANGED AS SPECIFIED ABOVE

CONTROLLER & CABINET

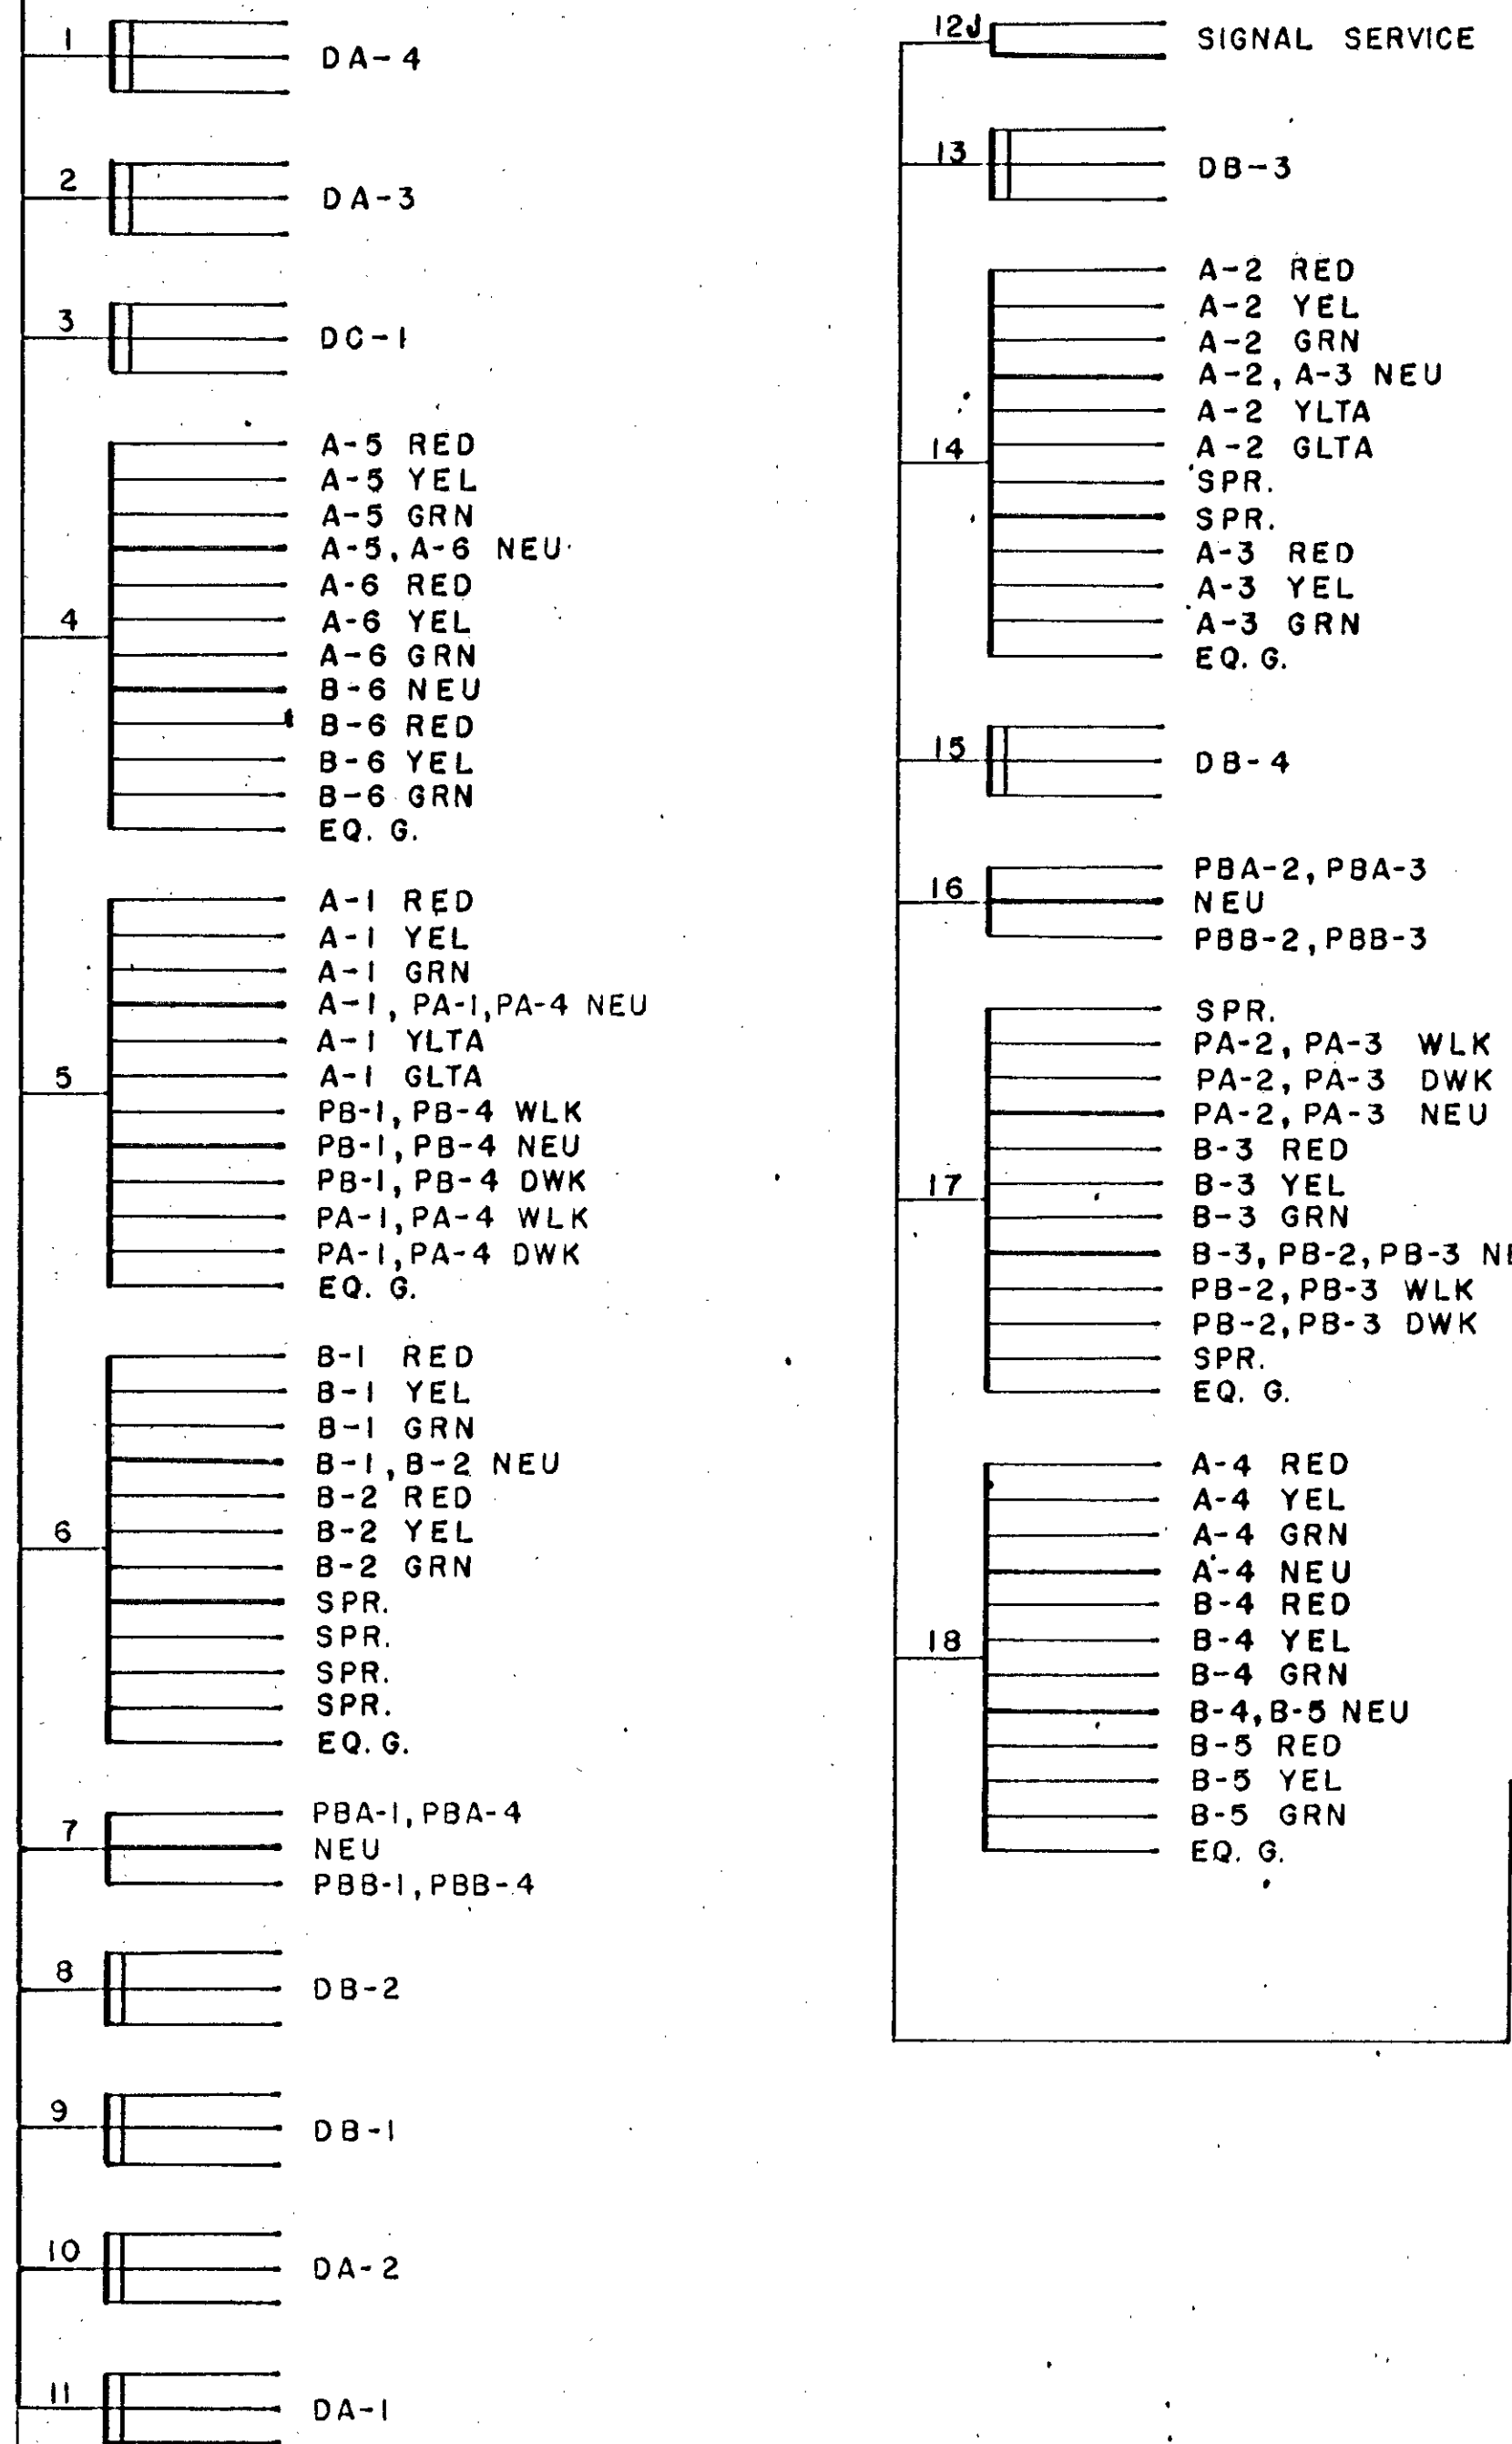

FIELD WIRING DIAGRAM
T.H. 242 AT C.S.A.H. 7
ANOKA