

COBALT TS2	LEGEND
■ CONFIGURATION: L3604 ■ SOFTWARE: 32.65.30 ■ ETHERNET MODULE □ OVERLAPS □ IN EEPROM □ KEYBOARD ENTERED A = B = C = D = □ ANALOG TELEMETRY MOD.: 100-1005-501 ■ INTERNAL RS-232 TELEMETRY □ TEST INPUT A = □ TEST INPUT B =	BIU BU() CB() C/C CCA CDP CMA CMB CPO CPP DR DS() FL() FR() LS() MC MP PAP PSP SA TB-() BUS INTERFACE UNIT C/C, BIU () CIRCUIT BREAKER () CONNECTING CABLE CONTROLLER CABLE "A" C/C, DR POWER MMU/CMU CABLE "A" MMU/CMU CABLE "B" C/C PRE-EMPT OUTPUTS C/C PRE-EMPT POWER DETECTOR RACK DOOR SWITCH () FLASHER () FLASH XFER. RELAY LOAD SWITCH MERCURY CONTACTOR MAIN PANEL POWER-AUX PANEL CAB. PWR. SUPPLY SURGE ARRESTOR TERM. BLOCK ()

FLASHER	
PIN	FUNCTION
7	CIRCUIT #1
8	CIRCUIT #2
9	CHASSIS GND
10	AC COMMON
11	115 VAC
12	-----

LOAD SWITCH	
PIN	FUNCTION
1	115 VAC
2	CHASSIS GND
3	RED/DW OUTPUT
4	-----
5	YEL OUTPUT
6	RED/DW INPUT
7	GRN/W OUTPUT
8	YEL INPUT
9	+24 VDC
10	GRN/W INPUT
11	AC COMMON
12	-----

①
2.2K
10W

3 USE ONLY COPPER CONDUCTORS FOR FIELD AND SERVICE CONNECTIONS.

2 CONNECT A.C. SERVICE TO TERMINAL BLOCK 501 (LINE), 502 (NEUTRAL) AND GB2 (EARTH) ON RIGHT SIDEWALL OF CABINET.

①INSTALL 2.2K, 10 WATT LOAD RESISTORS BETWEEN PINS 7 AND 11 ON LOAD SWITCHES 9, 10, 11 & 12.

NOTES: UNLESS SPECIFIED OTHERWISE

MAIN PANEL PLUG-IN REQUIREMENTS

BIU2 T&F	BIU3 T&F	LS9 PED 2 BEACONS	LS10 PED 4 BEACONS	LS11 PED 6 BEACONS	LS12 PED 8 BEACONS	LS13 OL "A"	LS14 OL "B"	LS15 OL "C"	LS16 OL "D"
BIU1 T&F	LS1 VEH 1	LS2 VEH 2	LS3 VEH 3	LS4 VEH 4	LS5 VEH 5	LS6 VEH 6	LS7 VEH 7	LS8 VEH 8	FL1 □1CKT ■2CKT
FR1 L R V1 V5	FR2 L R V2 V6	FR3 L R V3 V7	FR4 L R V4 V8	FR5 L R A C	FR6 L R B D	K1 LS 24V CONT.			

■ DENOTES TYPE OF OPERATION AND/OR WHERE PLUG-IN IS REQUIRED. L = LEFT, R = RIGHT.

⊠ DENOTES WHERE "UNUSED RED" JUMPER PART NUMBER 32448G1 IS REQUIRED. INSTALL BETWEEN PINS 1 & 3 FOR LOAD SWITCH OR PINS 6 & 8 AND 5 & 7 FOR FLASH TRANSFER RELAY.


FLASH:

□ ø2&6 YELLOW, ALL OTHERS RED.

■ ALL RED.





■ RELAYS DE-ENERGIZED FOR FLASH.

□ RELAYS ENERGIZED FOR FLASH.

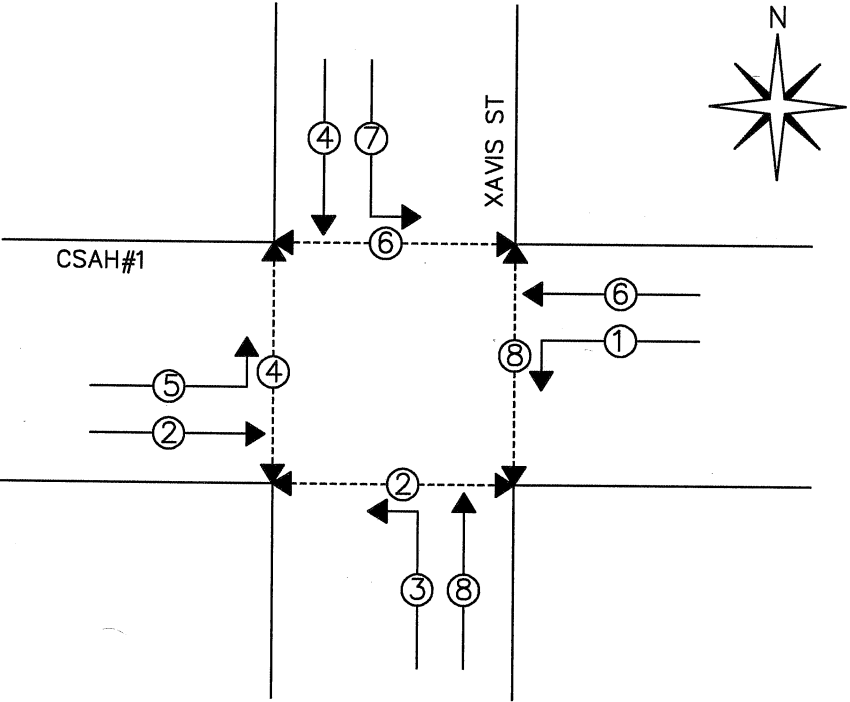

SHEET 1 OF 9

DESIGNER G.V. T.C.C.	DATE 02/22/2018	 ECONOLITE CONTROL PRODUCTS INC.		 TRAFFIC CONTROL CORPORATION		780 W. BELDEN SUITE D ADDISON, IL 60101	
DRAWN CM TCC	02/22/2018	CABINET SPECIFICATION: TS2TYPE1 ANOKA COUNTY SPEC PLUG AND GO					
CABINET SIZE	77"	CUSTOMER:					CONTROLLER
INSPECTED		INTERSECTION: CSAH#1 AT XAVIS ST					FLASHER
APPROVED		LOCATION:					SW.PACKS
		SYSTEM:					
CUSTOMER P.O.		INSTALLED BY	SALES ORDER NO.	SIZE B	DRAWING #TS2AC16PG-		

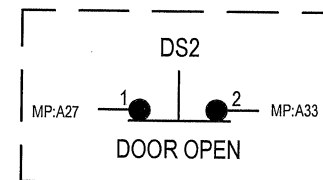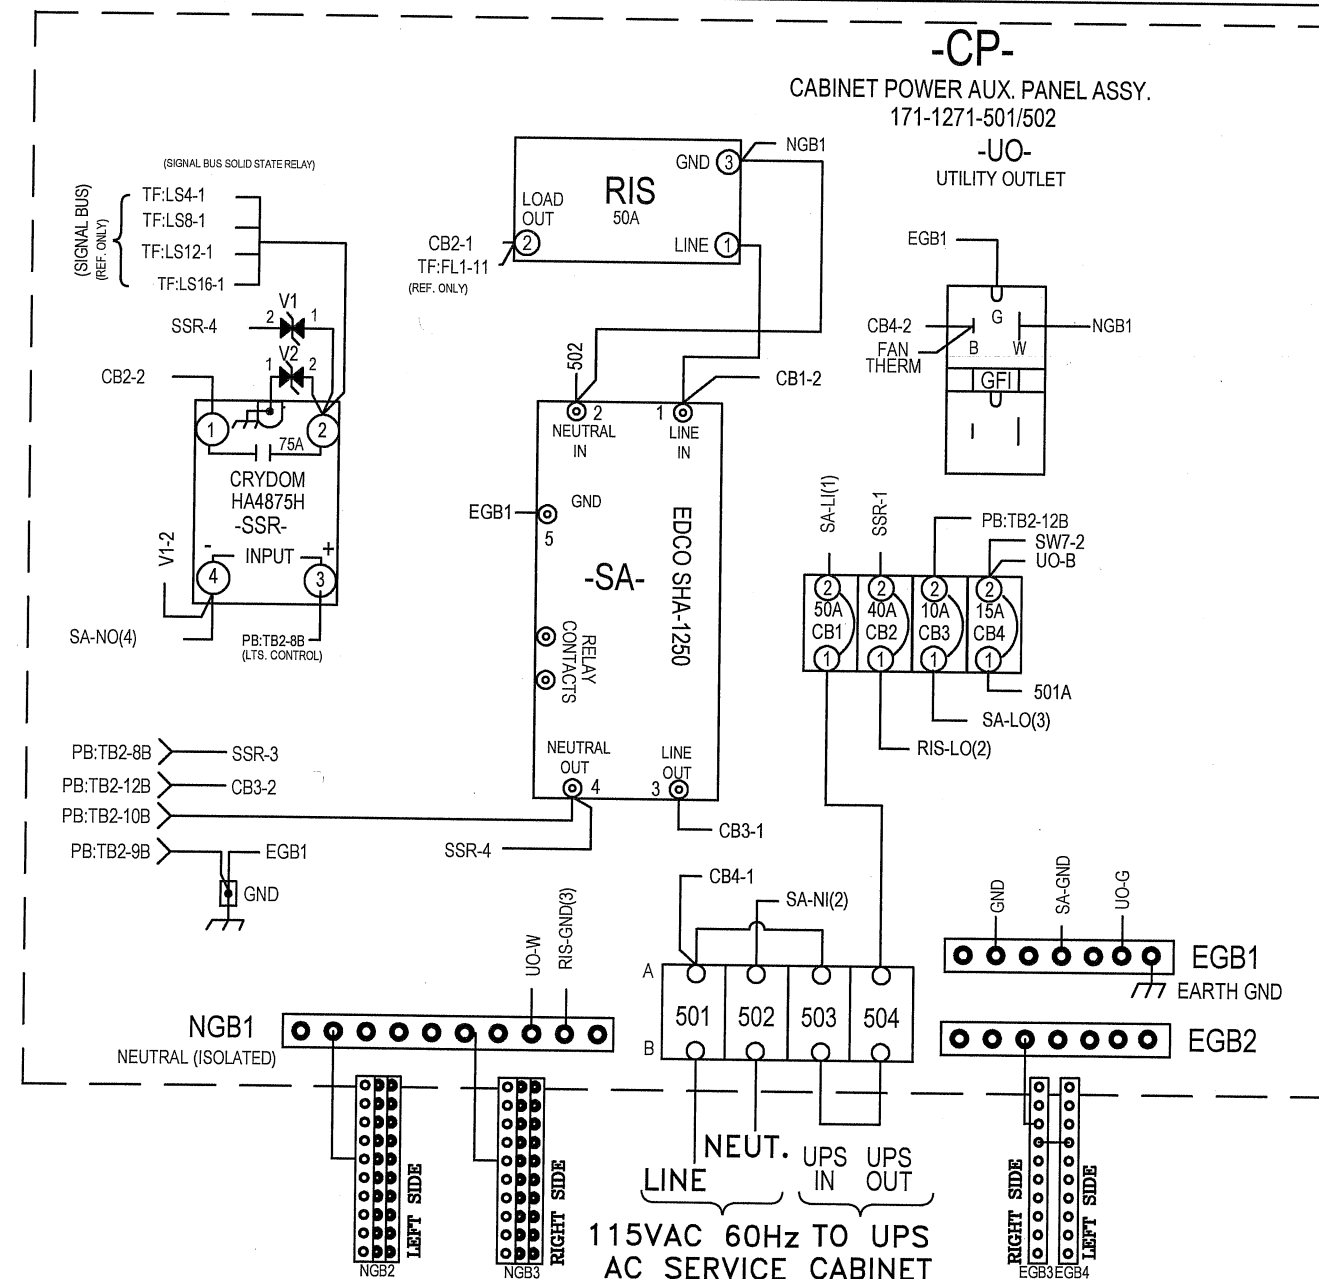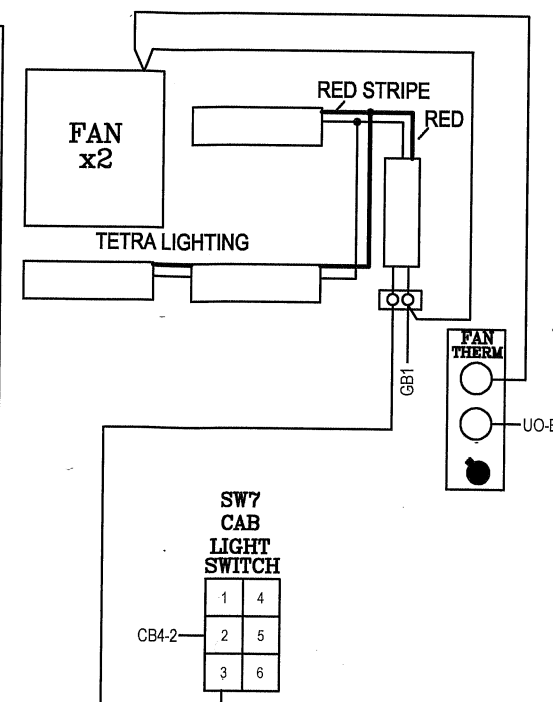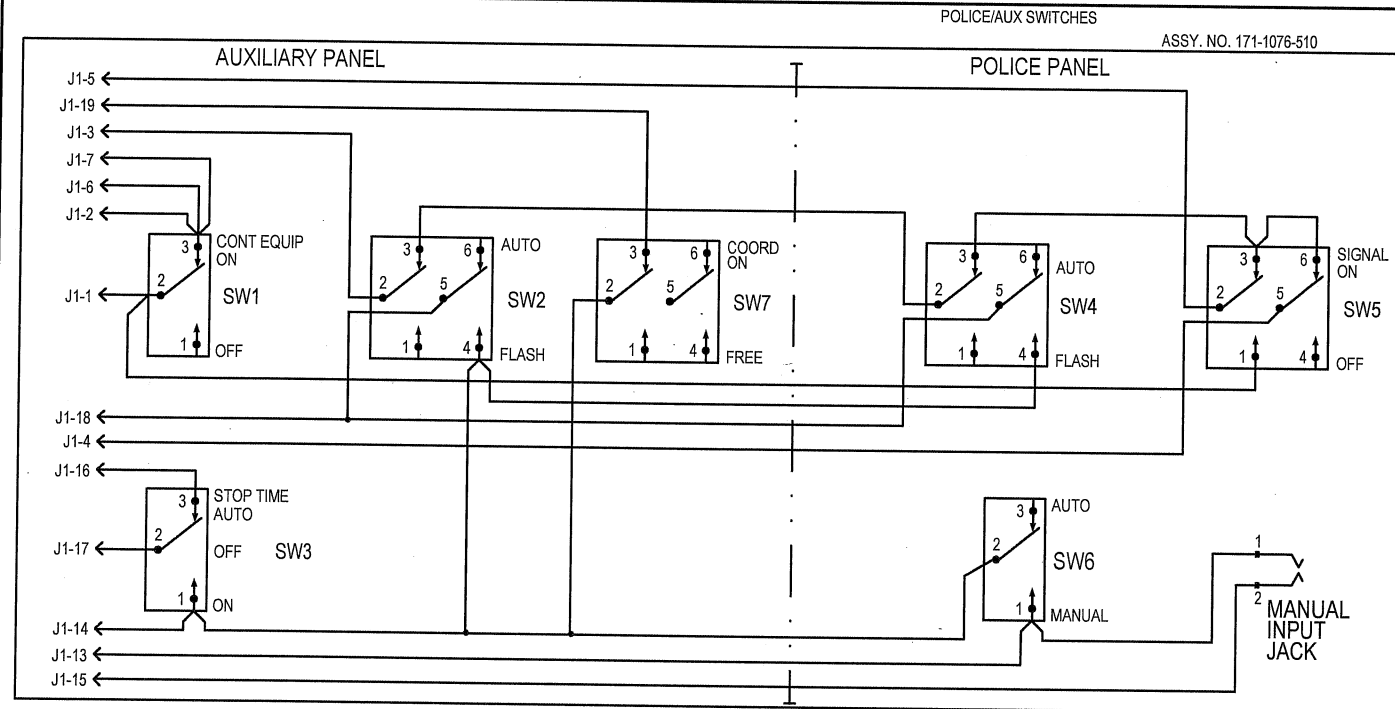

901	—	TB2-12 (120VAC+)
902	—	TB2-10 (120VAC-)
903	—	TB2-9 (CHASS. GND)
904		

AC POWER		C/C 171-1083-528/529
POWER BUS -PB-	FUNCTION	POWER PANEL -CP-
TB2-12B	FILTERED AC+LINE OUT	CB3-2
TB2-10B	AC NEUTRAL OUT	SA-NO
TB2-9B	EARTH GND.	GND
TB2-8B	SIG BUS CNTRL	SSR-3

J3

(MAIN PANEL & C/C REFERENCES ONLY)





TO/FROM POLICE-AUXILIARY SWITCH PANEL	
PIN	FUNCTION
1	FILTER AC LINE (OUT)
2	SWITCHED AC LINE (IN)
3	FLASH CONTROL BUS (OUT)
4	SIGNAL BUS CONTROL (IN)
5	FLASH RELAY CONTROL (IN)
6	START DELAY AC BUS (IN)
7	MMU FLASH CONTROL BUS (IN)
8	SPARE
9	SPARE
10	SPARE
11	SPARE
12	SPARE
13	MANUAL CONT. ENABLE (IN)
14	LOGIC GROUND
15	INTERVAL ADVANCE (IN)
16	MMU STOP TIME (OUT)
17	CONTROLLER STOP TIME (IN)
18	LOCAL FLASH STATUS (IN)
19	COORD FREE (IN)
20	ALARM 1 (IN)
21	ALARM 2 (IN)
22	LOADSWITCH TEST (IN)
23	MMU 24 VOLT MON. 2 (IN)
24	+24 VDC
25	LOGIC GROUND
26	+24 VDC (IN)
27	---
28	MMU FAULT MONITOR (IN)
29	LINE FREQ. REFERENCE (IN)
30	---
31	12 VAC (IN)
32	SIGNAL BUS CONTROL (IN)
33	---
34	FILTERED AC NEUTRAL (IN)
35	CONT. EQUIP. AC LINE (OUT)
36	FILTERED AC LINE (IN)
37	---

TO: POL/AUX ASSY.


TO: PBA

MP P3	MAIN PANEL/CONTROLLER PWR. C/C 171-1676-504	TO POL/AUX P1
PIN	FUNCTION	PIN
1	FILTER AC LINE (OUT)	1
2	SWITCHED AC LINE (IN)	2
3	FLASH CONTROL BUS (OUT)	3
4	SIGNAL BUS CONTROL (IN)	4
5	FLASH RELAY CONTROL (IN)	5
6	START DELAY AC BUS (IN)	6
7	MMU FLASH CONTROL BUS (IN)	7
8	SPARE	8
9	SPARE	9
10	SPARE	10
11	SPARE	11
12	SPARE	12
13	OPT-MANUAL CONT. ENABLE (IN)	13
14	LOGIC GROUND	14
15	OPT-INTERVAL ADVANCE (IN)	15
16	MMU STOP TIME (OUT)	16
17	CONTROLLER STOP TIME (IN)	17
18	LOCAL FLASH STATUS (IN)	18
19	OPT-COORD FREE (IN)	19
20	OPT-ALARM 1 (IN)	20
21	OPT-ALARM 2 (IN)	21
22	OPT-LOADSWITCH TEST (IN)	22
23	MMU 24 VOLT MON. 2 (IN)	23
24	+24 VDC	24
PART OF 171-1076-504		TO PB:(JX)
25	LOGIC GROUND	1
26	+24 VDC (IN)	2
(N/U)	---	3
28	MMU FAULT MONITOR (IN)	4
29	LINE FREQ. REFERENCE (IN)	5
(N/U)	---	6
31	12 VAC (IN)	7
32	SIGNAL BUS CONTROL (IN)	8
(N/U)	---	9
34	FILTERED AC NEUTRAL (IN)	10
35	CONT. EQUIP. AC LINE (OUT)	11
36	FILTERED AC LINE (IN)	12
(N/U)	---	13
(N/U)	---	14

CONFIRMATION BEACONS	
EVP 3	= 1-6
EVP 4	= 2-5
EVP 5	= 3-8
EVP 6	= 4-7

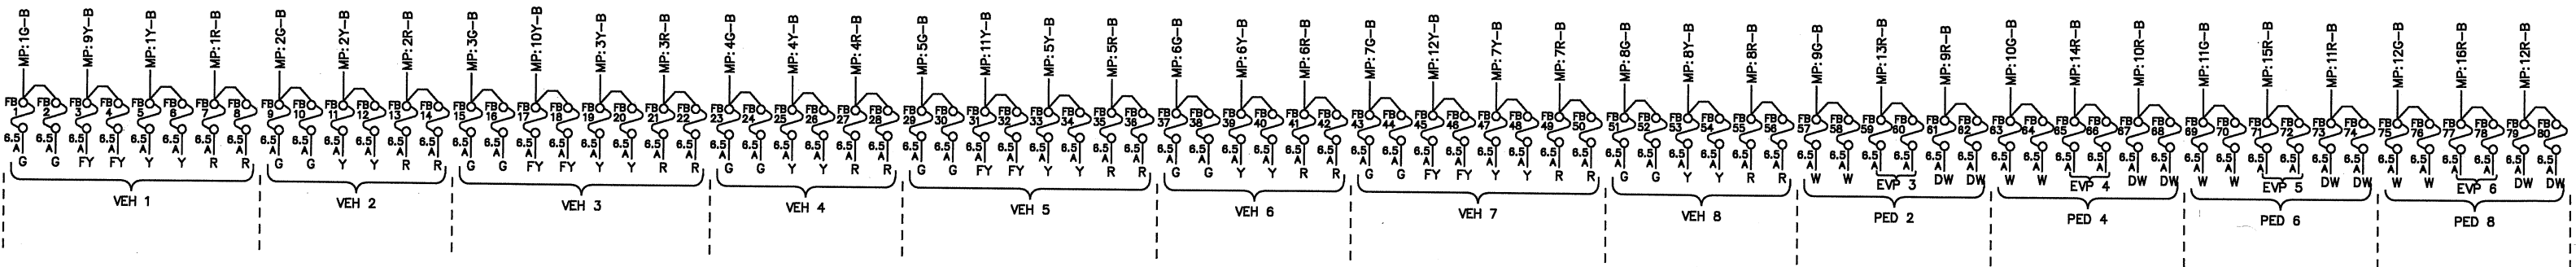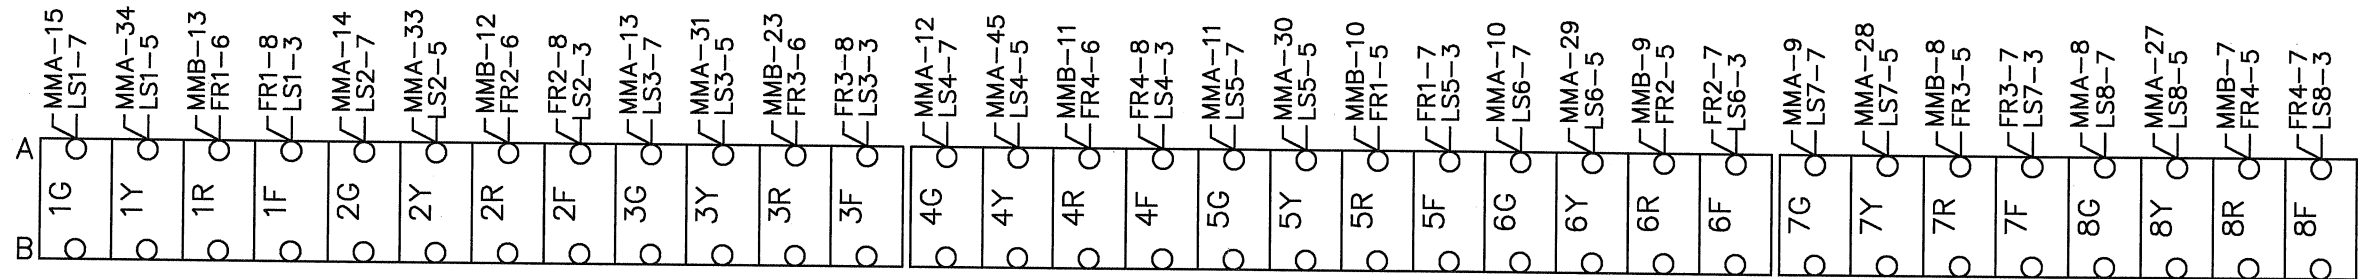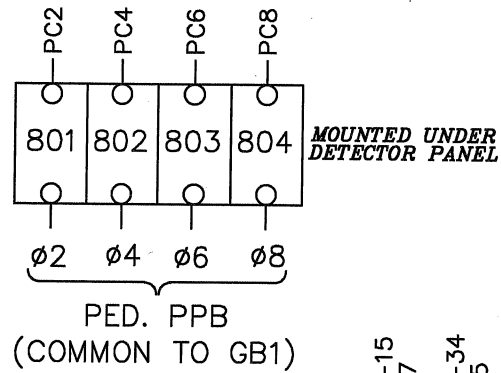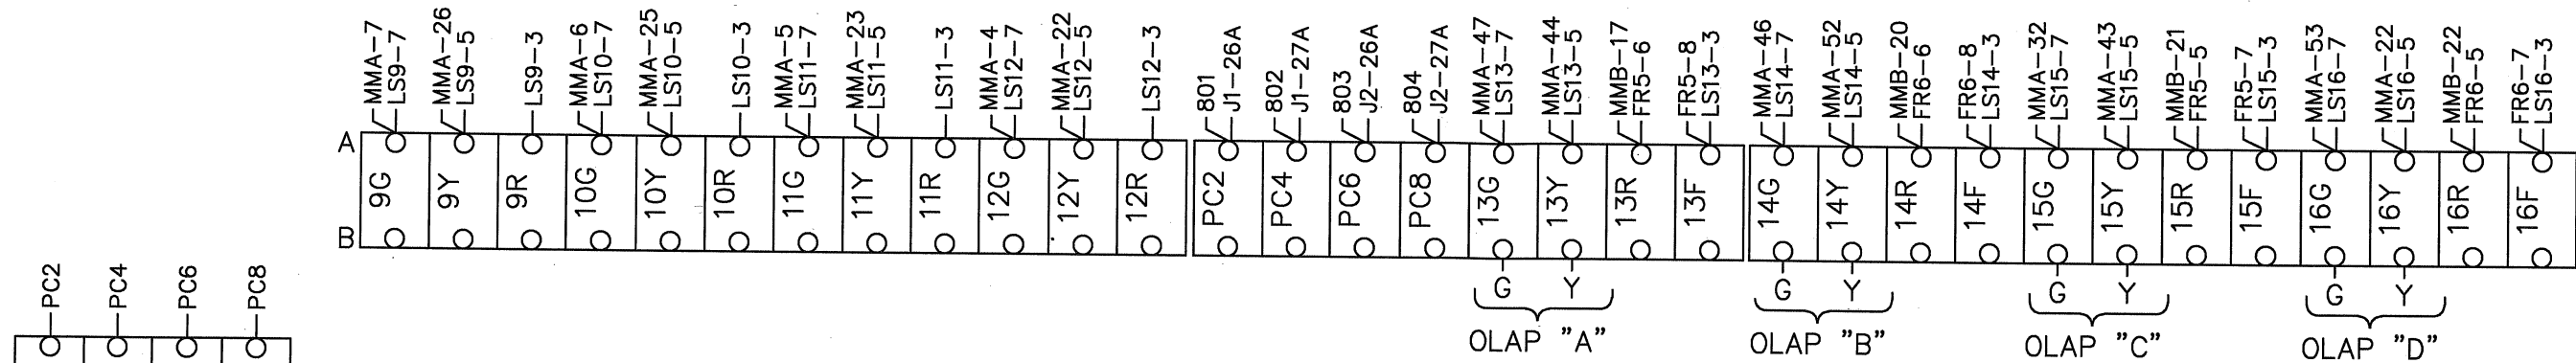

SIGNAL FIELD TERMINALS

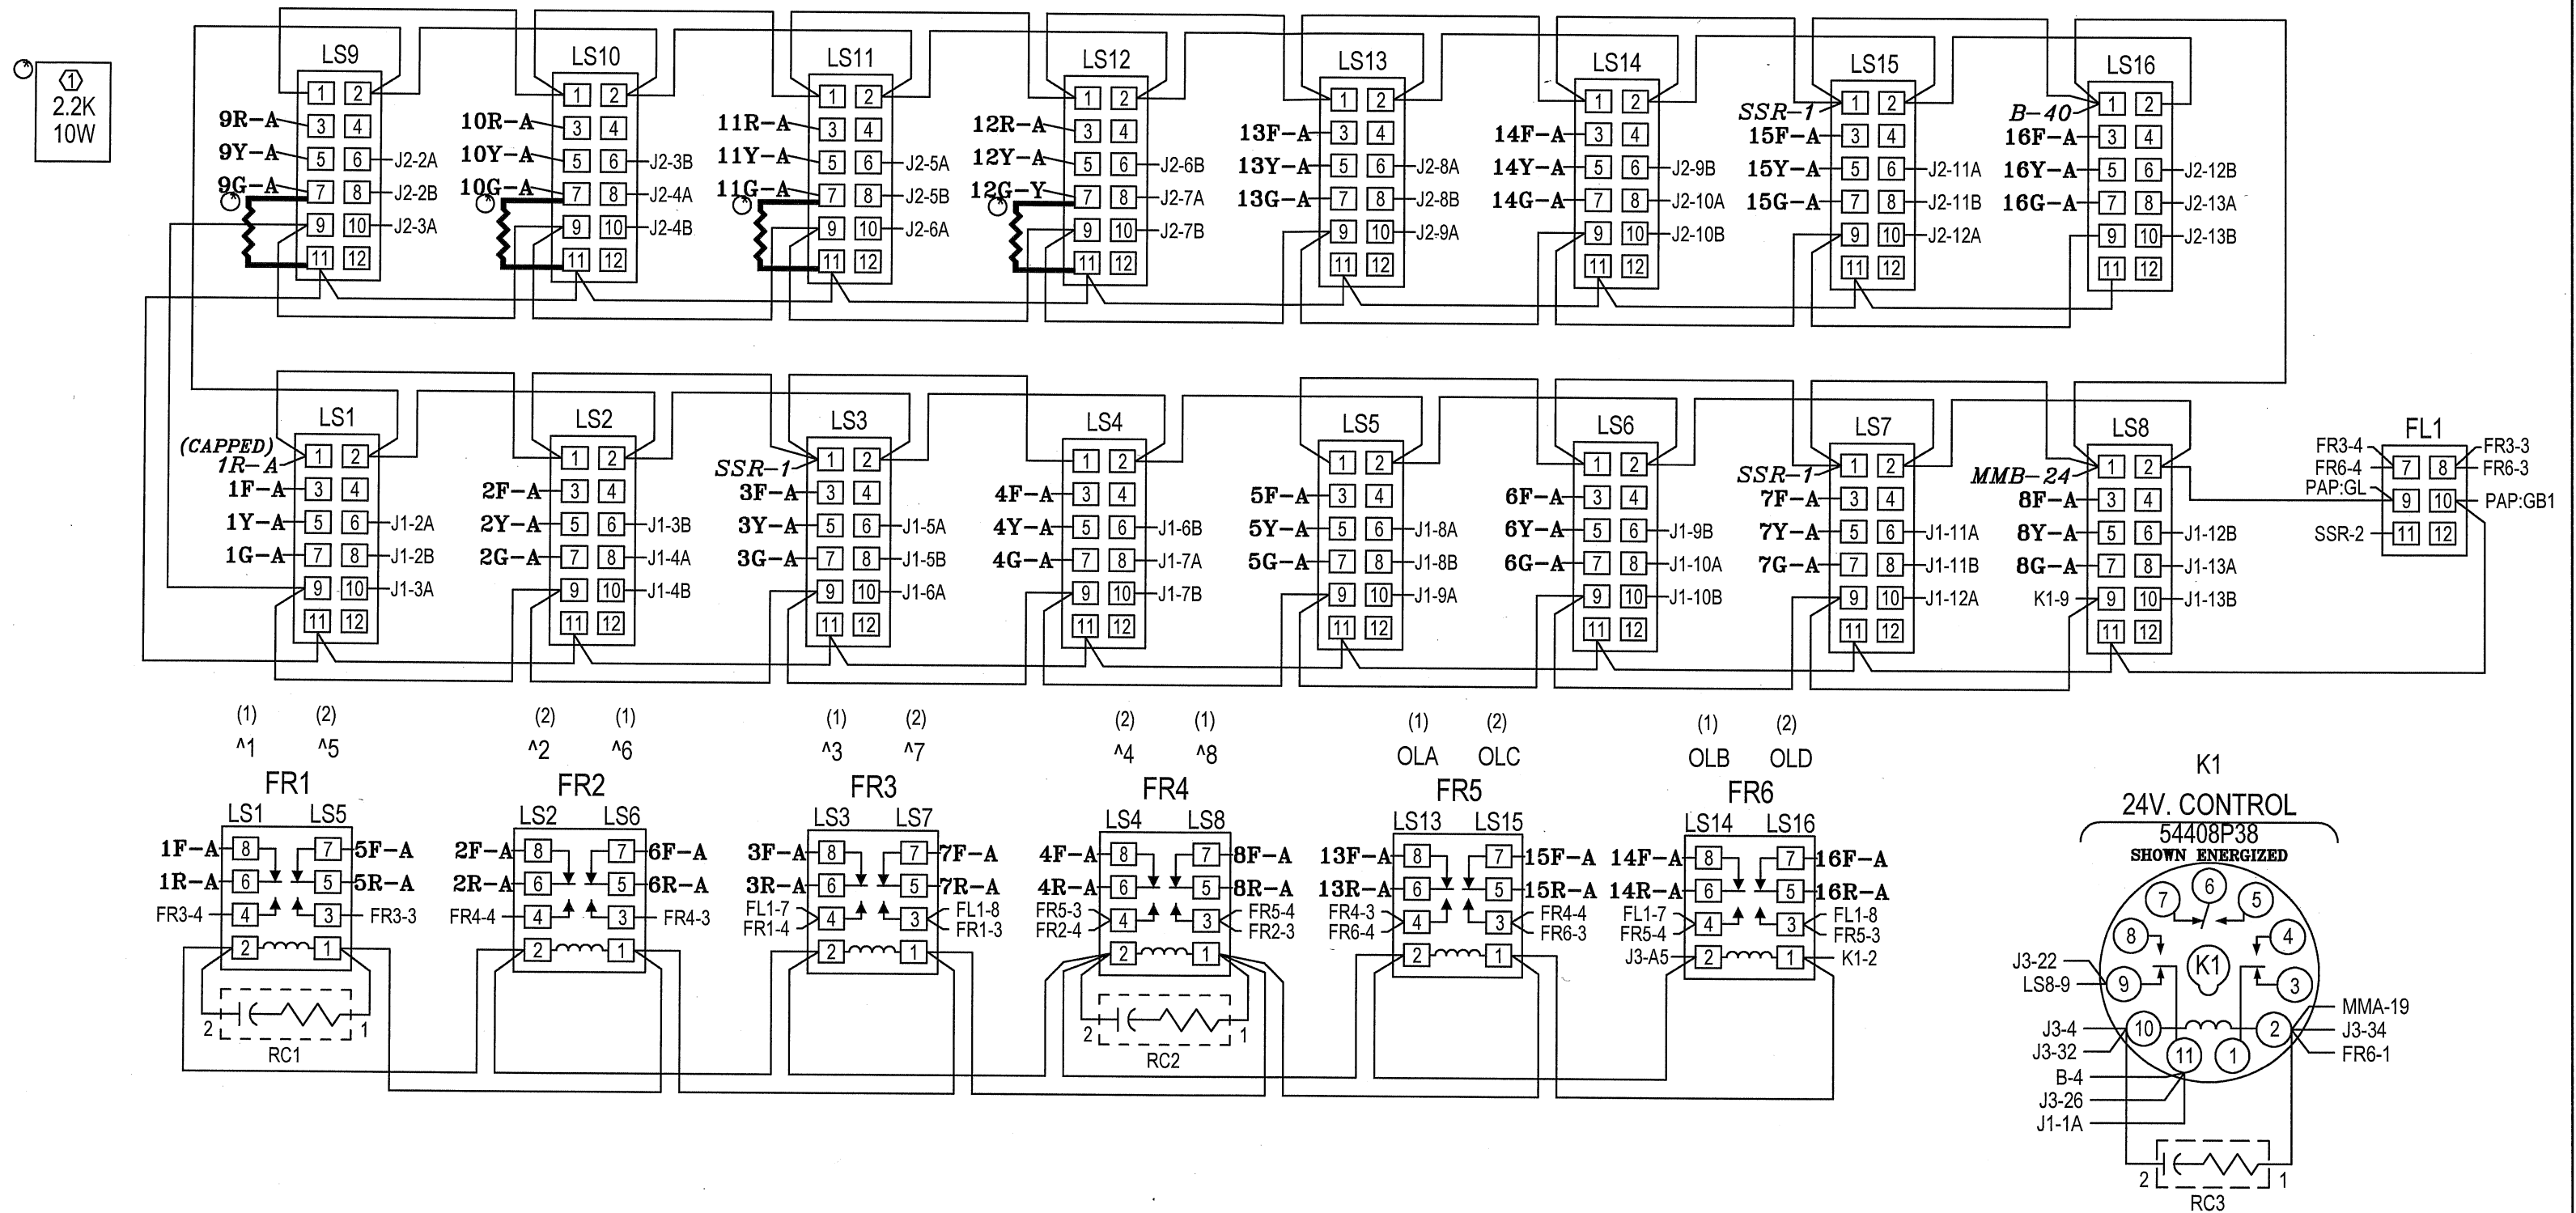

LOADBAY AND FLASH RELAY'S

SHEET 4 OF 9

SIZE
B

CSAH#1 AT XAVIS ST

B	A	1	MMU, RESET	MMA-49J2-21B	RG. 1 INHBT. MAX.
		2	24 V. MON. INHBT.	MMA-36J2-22A	RG. 2 INHBT. MAX.
		3	MMU, +24 V. MON. 2	J3-23 J1-23B	RG. 1 FORCE OFF
		4	MMU, +24 V. MON. 1	K1-11 J3-24 J1-24A	RG. 2 FORCE OFF
		5	FAULT MON.	J3-28 J1-22B	RG. 1 MAX. 2 SEL.
		6	PC1 PED. DET. 1	MMA-35 J1-25B J1-23A	RG. 2 MAX. 2 SEL.
		7	PC3 PED. DET. 3	J1-26B J1-24B	CALL NONACT. 1
		8	PC5 PED. DET. 5	J2-25B J2-19A	CALL NONACT. 2
		9	PC7 PED. DET. 7	J2-26B J1-25A	WALK REST MDR.
		10	DET. 61	J2-19B J1-20A	EXT. MIN. RECALL
		11	DET. 62	J2-20A J1-20B	EXT. START
		12	DET. 63	J2-20B J1-17A	TEST INPUT A
		13	DET. 64	J2-21A J1-17B	TEST INPUT B
		14	LOGIC GND.	MMA-17 J1-32A J2-25A A-20	TEST INPUT C
		15	PMT. CALL 1	J1-16A J1-21A	T.B.C. ON LINE
		16	PMT. CALL 2	J1-16B J1-14A	T.B.C. AUX. 1
		17	PMT. CALL 3	J2-17A J1-14B	T.B.C. AUX. 2
		18	PMT. CALL 4	J2-17B J2-14A	T.B.C. AUX. 3
		19	PMT. CALL 5	J2-18A J2-14B	COORD. STATUS OUT
		20	PMT. CALL 6	J2-18B MMA-55 A-27	LOGIC GND.

21	MMA AC+ I IN	MMA-1 J1-15A	PMT. 1 ACTV.
22	DR1 OPEN	MMA-2 J1-15B	PMT. 2 ACTV.
23	DR2 CLSD	MMA-3 J2-15A	ALARM 3
24	MMA SPR 1	MMA-48 J2-15B	ALARM 4
25	CAB INTLK A	MMA-50 J2-16A	ALARM 5
26	CAB INTLK B	MMA-51 J2-16B	ALARM 6
27	MMA SPR 2	MMA-54 A-35 MMA-21 A-20	LOGIC GND
28	SDR OPEN	MMB-3	LOGIC GND
29	MMB SPR 1	MMB-14	LOGIC GND
30	MMB SPR 2	MMB-16 J1-21B J1-22A J3-17	STOP TIMING 1 & 2
31	MMB SPR 3	MMB-38 MMA-38 MMA-25 J2-23A J3-16	MMU STOP TIMING
32		MMB-26 J2-22B J3-18	LOCAL FLASH STATUS
33		J2-23B J3-20	ALARM 1
34		J2-24A J3-21	ALARM 2
35		A-27 J3-25 J3-14	LOGIC GND
36		J1-18B	DIM. ENABLE
37	SB AC+	MMB-4 J1-18A	AUTO FLASH
38	SB AC+	J2-24B J3-19	COORD. FREE
39	SB AC+	J1-19A J3-13	MANUAL CONT. ENABLE
40	SB AC+	J1-19B J3-15	INTRVL ADV.

INTERFACE TERMINAL BLOCKS

J1	BIU #1	
PIN	FUNCTION	TO
1A	+24 VDC	K1-11
1B	+24 VDC	J2-1B
2A	LS1 RED	LS1-6
2B	LS1 YELLOW	LS1-8
3A	LS1 GREEN	LS1-10
3B	LS2 RED	LS2-6
4A	LS2 YELLOW	LS2-8
4B	LS2 GREEN	LS2-10
5A	LS3 RED	LS3-6
5B	LS3 YELLOW	LS3-8
6A	LS3 GREEN	LS3-10
6B	LS4 RED	LS4-6
7A	LS4 YELLOW	LS4-8
7B	LS4 GREEN	LS4-10
8A	LS5 RED	LS5-6
8B	LS5 YELLOW	LS5-8
9A	LS5 GREEN	LS5-10
9B	LS6 RED	LS6-6
10A	LS6 YELLOW	LS6-8
10B	LS6 GREEN	LS6-10
11A	LS7 RED	LS7-6
11B	LS7 YELLOW	LS7-8
12A	LS7 GREEN	LS7-10
12B	LS8 RED	LS8-6
13A	LS8 YELLOW	LS8-8
13B	LS8 GREEN	LS8-10
14A	TBC AUX 1	A-16
14B	TBC AUX 2	A-17
15A	PMT ACT 1	A-21
15B	PMT ACT 2	A-22
16A	PMT CALL 1	B-15
16B	PMT CALL 2	B-16
17A	TEST A	A-12
17B	TEST B	A-13
18A	AUTO FLASH	A-37
18B	DIM. ENABLE	A-36
19A	MANUAL CONT.	A-39
19B	INT. ADVANCE	A-40
20A	EXT. MIN. RECALL	A-10
20B	EXT. START	A-11
21A	TBC ONLINE	A-15
21B	STOP TIME (1)	A-30
22A	STOP TIME (2)	A-30
22B	MAX. 2 (1)	A-5
23A	MAX. 2 (2)	A-6
23B	FORCE OFF (1)	A-3
24A	FORCE OFF (2)	A-4
24B	CNA 1	A-7
25A	WALK REST MOD.	A-9
25B	PED. ISO. 1	B-6
26A	PED. ISO. 2	PC2-A
26B	PED. ISO. 3	B-7
27A	PED. ISO. 4	PC4-A
27B	PED. ISO. COMN.	J3-D1
28A	ADDR. SEL. 0	----
28B	ADDR. SEL. 1	----
29A	ADDR. SEL. 2	----
29B	ADDR. SEL. 3	----
30A	RESERVED	----
30B	RESERVED	----
31A	EARTH GND.	LS12-2
31B	LINE FREQ. REF.	J3-C9
32A	LOGIC GND.	B-14
32B	LOGIC GND.	J2-32A

J2	BIU #2	
PIN	FUNCTION	TO
1A	+24 VDC	J2-1B
1B	+24 VDC	J1-1B
2A	LS9 RED	LS9-6
2B	LS9 YELLOW	LS9-8
3A	LS9 GREEN	LS9-10
3B	LS10 RED	LS10-6
4A	LS10 YELLOW	LS10-8
4B	LS10 GREEN	LS10-10
5A	LS11 RED	LS11-6
5B	LS11 YELLOW	LS11-8
6A	LS11 GREEN	LS11-10
6B	LS12 RED	LS12-6
7A	LS12 YELLOW	LS12-8
7B	LS12 GREEN	LS12-10
8A	LS13 RED	LS13-6
8B	LS13 YELLOW	LS13-8
9A	LS13 GREEN	LS13-10
9B	LS14 RED	LS14-6
10A	LS14 YELLOW	LS14-8
10B	LS14 GREEN	LS14-10
11A	LS15 RED	LS15-6
11B	LS15 YELLOW	LS15-8
12A	LS15 GREEN	LS15-10
12B	LS16 RED	LS16-6
13A	LS16 YELLOW	LS16-8
13B	LS16 GREEN	LS16-10
14A	TBC AUX 3	A-18
14B	COORD. STATUS	A-19
15A	ALARM 3	A-23
15B	ALARM 4	A-24
16A	ALARM 5	A-25
16B	ALARM 6	A-26
17A	PMT CALL 3	B-17
17B	PMT CALL 4	B-18
18A	PMT CALL 5	B-19
18B	PMT CALL 6	B-20
19A	CNA 2	A-8
19B	SPARE 1	B-10
20A	SPARE 2	B-11
20B	SPARE 3	B-12
21A	SPARE 4	B-13
21B	INHIBIT MAX (1)	A-1
22A	INHIBIT MAX (2)	A-2
22B	LOCAL FLASH	A-32
23A	MMU FLASH	A-31
23B	ALARM 1	A-33
24A	ALARM 2	A-34
24B	COORD FREE IN	A-38
25A	TEST C	A-14
25B	PED. ISO. 5	B-8
26A	PED. ISO. 6	PC6-A
26B	PED. ISO. 7	B-9
27A	PED. ISO. 8	PC8-A
27B	PED. ISO. COMN.	J1-27B
28A	ADDR. SEL. 0	J2-32A
28B	ADDR. SEL. 1	----
29A	ADDR. SEL. 2	----
29B	ADDR. SEL. 3	----
30A	RESERVED	----
30B	RESERVED	----
31A	EARTH GND.	J1-31A
31B	LINE FREQ. REF.	J1-31B
32A	LOGIC GND.	J1-32B
32B	LOGIC GND.	J2-32A

DETECTOR BIU	
PIN	FUNCTION
1A	+24 VDC
1B	+24 VDC
2A	
2B	
3A	
3B	
4A	
4B	
5A	
5B	
6A	
6B	
7A	
7B	
8A	
8B	
9A	
9B	CH. 1 CALL
10A	CH. 2 CALL
10B	CH. 3 CALL
11A	CH. 4 CALL
11B	CH. 5 CALL
12A	CH. 6 CALL
12B	CH. 7 CALL
13A	CH. 8 CALL
13B	CH. 9 CALL
14A	CH. 10 CALL
14B	CH. 11 CALL
15A	CH. 12 CALL
15B	CH. 13 CALL
16A	CH. 14 CALL
16B	CH. 15 CALL
17A	CH. 16 CALL
17B	CH. 1 FAULT STATUS
18A	CH. 2 FAULT STATUS
18B	CH. 3 FAULT STATUS
19A	CH. 4 FAULT STATUS
19B	CH. 5 FAULT STATUS
20A	CH. 6 FAULT STATUS
20B	CH. 7 FAULT STATUS
21A	CH. 8 FAULT STATUS
21B	CH. 9 FAULT STATUS
22A	CH. 10 FAULT STATUS
22B	CH. 11 FAULT STATUS
23A	CH. 12 FAULT STATUS
23B	CH. 13 FAULT STATUS
24A	CH. 14 FAULT STATUS
24B	CH. 15 FAULT STATUS
25A	CH. 16 FAULT STATUS
25B	
26A	
26B	
27A	
27B	
28A	ADDR. SEL. 0
28B	ADDR. SEL. 1
29A	ADDR. SEL. 2
29B	ADDR. SEL. 3
30A	
30B	
31A	EARTH GND.
31B	LINE FREQ. REF.
32A	LOGIC GND.
32B	LOGIC GND.

MAIN PANEL CONTROL POWER C/C 171-1676-504	
PIN	FUNCTION
1	LOGIC GROUND
2	+24 VDC (IN)
3	----
4	MMU FAULT MONITOR (IN)
5	LINE FREQ. REFERENCE (IN)
6	----
7	+12 VAC (IN)
8	SIGNAL BUS CONTROL (IN)
9	----
10	FILTERED AC NEUTRAL (IN)
11	CONT. EQUIP. AC LINE (OUT)
12	FILTERED AC LINE (IN)
13	----
14	----


CONTROLLER POWER (CCA2) C/C 171-1676-503			
WIRE	PIN	SIGNAL	TO
1	A	FAULT MONITOR	PB-4
2	U	AC NEUTRAL	PB-10
3	V	EARTH GROUND	PB-9
4	W	LOGIC GROUND	PB-1
5	P	AC LINE	PB-11
6	SHL	EARTH GROUND	CCA2-V

TYPE 1 CONTROLLER POWER C/C 171-1676-502		
PIN	FUNCTION	TO
A	AC NEUTRAL	PB-10
B	----	----
C	AC LINE	PB-11
D	----	----
E	+	+
F	FAULT MON.	PB-4
G	LOGIC GND.	PB-1
H	EARTH GND.	PB-9
I	+	+
J	RESERVED	----
SHL	EARTH GND.	PB-6


CABINET POWER SUPPLY C/C 171-1676-511		
PIN	FUNCTION	TO
A	AC NEUTRAL	PB-10
B	LINE FREQUENCY REF.	PB-5
C	AC LINE	PB-11
D	+12 VDC	PB-3
E	+24 VDC	PB-2
F	RESERVED	----
G	LOGIC GND.	PB-1
H	EARTH GND.	PB-9
I	+12 VAC	PB-7
J	RESERVED	----
SHL	EARTH GND.	PIN H

CONTROLLER PORT 1 CONNECTOR			
PIN	SIGNAL	TO	FUNCTION
1	TWISTED PAIR 1+	SDLC-1	CONT TXD+
2	LOGIC GND.	----	----
3	TWISTED PAIR 2+	SDLC-4	CONT TXC+
4	LOGIC GND.	----	----
5	TWISTED PAIR 3+	SDLC-7	CONT RXD+
6	LOGIC GND.	----	----
7	TWISTED PAIR 4+	SDLC-10	CONT RXC+
8	LOGIC GND.	----	----
9	TWISTED PAIR 1-	SDLC-2	CONT TXD-
10	PORT 1 DISABLE	----	----
11	TWISTED PAIR 2-	SDLC-5	CONT TXC-
12	EARTH GND.	SHIELD WIRE	CONT RXD-
13	TWISTED PAIR 3-	SDLC-8	CONT RXD-
14	RESERVED	----	----
15	TWISTED PAIR 4-	SDLC-11	CONT RXC-


MMU & BIU PORT 1 CONNECTOR			
PIN	SIGNAL	TO	FUNCTION
1	TWISTED PAIR 1+	SDLC-1	BIU RXD+
2	LOGIC GND.	----	----
3	TWISTED PAIR 2+	SDLC-4	BIU RXC+
4	LOGIC GND.	----	----
5	TWISTED PAIR 3+	SDLC-7	BIU TXD+
6	LOGIC GND.	----	----
7	TWISTED PAIR 4+	SDLC-10	BIU TXC+
8	LOGIC GND.	----	----
9	TWISTED PAIR 1-	SDLC-2	BIU RXD-
10	PORT 1 DISABLE	----	----
11	TWISTED PAIR 2-	SDLC-5	BIU RXC-
12	EARTH GND.	SHIELD WIRE	BIU TXD-
13	TWISTED PAIR 3-	SDLC-8	BIU TXD-
14	RESERVED	----	----
15	TWISTED PAIR 4-	SDLC-11	BIU TXC-



FRONT VIEW OF BU1 - BU5



FRONT VIEW OF J1-J6

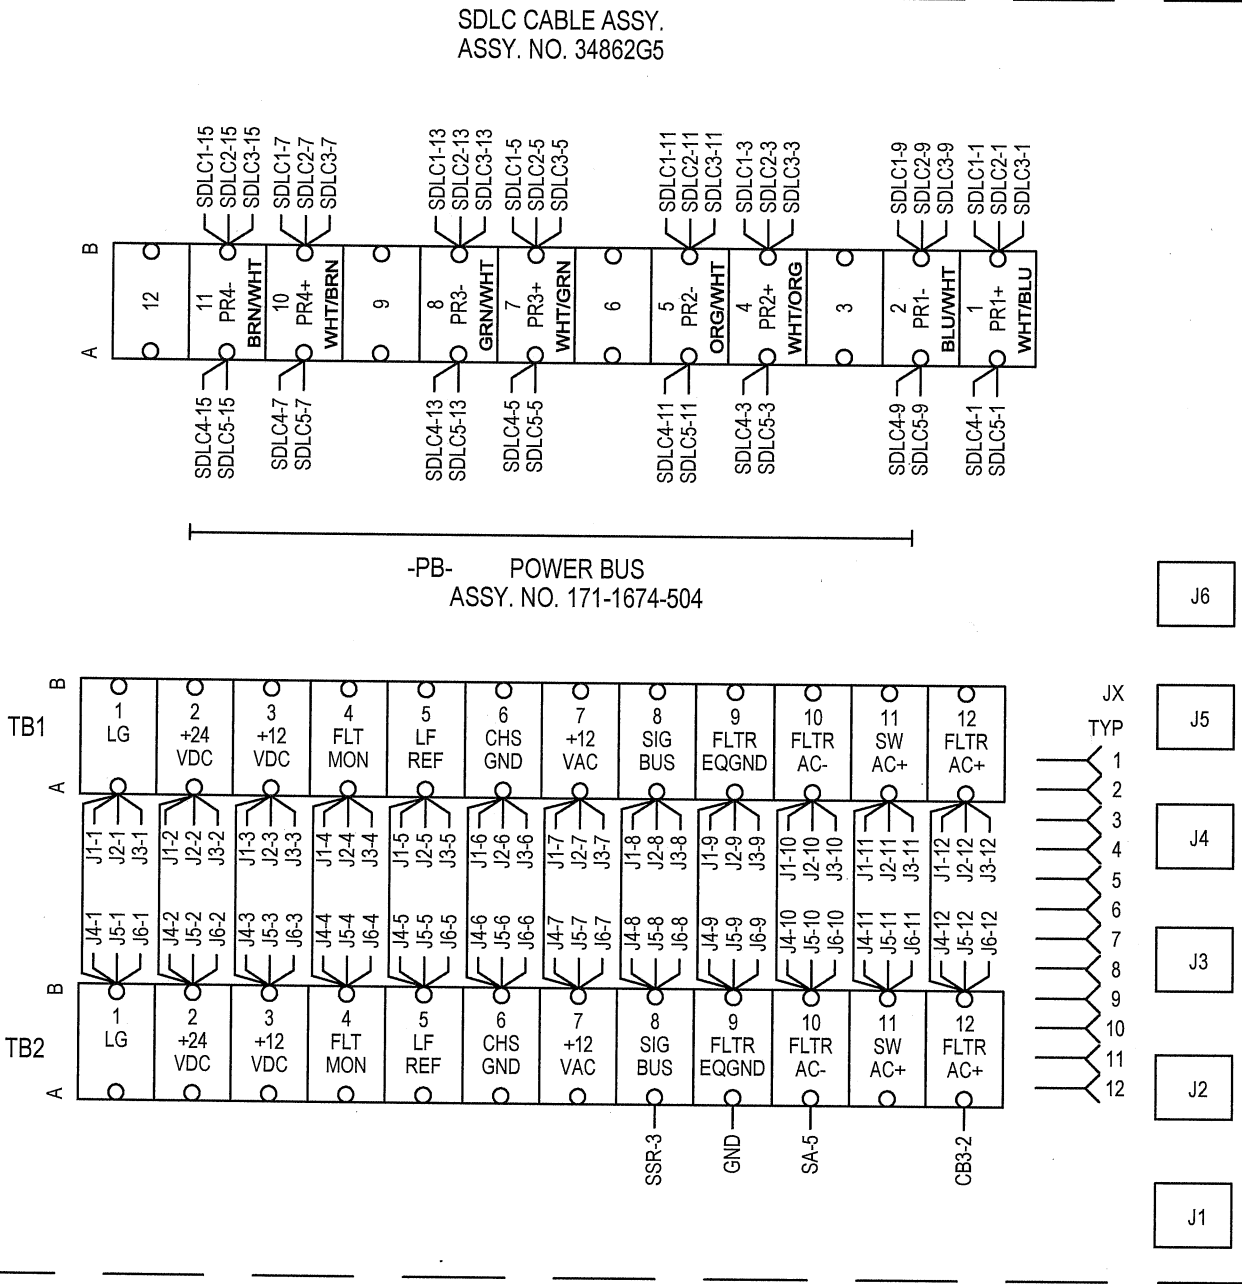

SDLC CABLE ASSY.
ASSY. NO. 34862G5

-PB- POWER BUS
ASSY. NO. 171-1674-504

BIU AND CONNECTING CABLES

WIRE LIST FOR NEMA MALFUNCTION MANAGEMENT UNIT

CONNECTOR "A" (MMA)					CONNECTOR "B" (MMB)																																																				
PIN	WIRE	MON. FUNCTION	TO	SIG. FUNCTION	PIN	WIRE	MON. FUNCTION	TO	SIG. FUNCTION																																																
A	A-1	AC+ I INPUT	B21		A	B-1	AC+ II INPUT	J3-A2	MMU POWER																																																
B	A-2	OUT RLY 1 OPEN	B22		B	B-2	S. DLY RLY COMM.	J3-A6	MMU POWER																																																
C	A-3	OUT RLY 2 CLSD	B23		C	B-3	S. DLY RLY OPEN	B28																																																	
D	A-4	CH. 12 GREEN	12G-A	^8 WLK	D	B-4	CH. 12 RED	B40																																																	
E	A-5	CH. 11 GREEN	11G-A	^6 WLK	E	B-5	CH. 11 RED	B39																																																	
F	A-6	CH. 10 GREEN	10G-A	^4 WLK	F	B-6	CH. 9 RED	B37																																																	
G	A-7	CH. 9 GREEN	9G-A	^2 WLK	G	B-7	CH. 8 RED	8R-A	^8 RED																																																
H	A-8	CH. 8 GREEN	8G-A	^8 GRN	H	B-8	CH. 7 RED	7R-A	^7 RED																																																
J	A-9	CH. 7 GREEN	7G-A	^7 GRN	J	B-9	CH. 6 RED	6R-A	^6 RED																																																
K	A-10	CH. 6 GREEN	6G-A	^6 GRN	K	B-10	CH. 5 RED	5R-A	^5 RED																																																
L	A-11	CH. 5 GREEN	5G-A	^5 GRN	L	B-11	CH. 4 RED	4R-A	^4 RED																																																
M	A-12	CH. 4 GREEN	4G-A	^4 GRN	M	B-12	CH. 2 RED	2R-A	^2 RED																																																
N	A-13	CH. 3 GREEN	3G-A	^3 GRN	N	B-13	CH. 1 RED	1R-A	^1 RED																																																
P	A-14	CH. 2 GREEN	2G-A	^2 GRN	P	B-14	(SPARE 1)	B29																																																	
R	A-15	CH. 1 GREEN	1G-A	^1 GRN	R	B-15	+24V MONITOR II	B-3	+24V MON. II																																																
S	A-16	+24V MON. I	B-4	LS +24V MON.	S	B-16	(SPARE 2)	B30																																																	
T	A-17	LOGIC GND	B-14	LOGIC GND	T	B-17	CH. 13 RED	13R-A	OLA RED																																																
U	A-18	CHASSIS GND	LS7-2	EARTH GND.	U	B-18	S. DLY RLY CLSD	J3-D5	CONT. POWER																																																
V	A-19	AC- (COMMON)	K1-2	AC NEUTRAL	V	B-19	CH. 10 RED	B38																																																	
W	A-20	OUT RLY 1 COM.	J3-A7	SIG BUS CONT	W	B-20	CH. 14 RED	14R-A	OLB RED																																																
X	A-21	OUT RLY 2 COM.	A-27	LOGIC GND	X	B-21	CH. 15 RED	15R-A	OLC RED																																																
Y	A-22	CH. 12 YELLOW	12Y-A	VEH. 7 FYA	Y	B-22	CH. 16 RED	16R-A	OLD RED																																																
Z	A-23	CH. 11 YELLOW	11Y-A	VEH. 5 FYA	Z	B-23	CH. 3 RED	3R-A	^3 RED																																																
a	A-24	CH. 10 WALK	----		a	B-24	RED ENABLE	LS8-1	SIG BUS CON.																																																
b	A-25	CH. 10 YELLOW	10Y-A	VEH. 3 FYA	b	B-25	(SPARE 3)	B31																																																	
c	A-26	CH. 9 YELLOW	9Y-A	VEH. 1 FYA	c	B-26	LOCAL FLASH IN	A32	POL/AX FLSH																																																
d	A-27	CH. 8 YELLOW	8Y-A	^8 YEL		B-27	SHELL GROUND	LS6-2	EARTH GND.																																																
e	A-28	CH. 7 YELLOW	7Y-A	^7 YEL	NOTES FOR 16 CHANNEL M.M.U. (1) RELAY CONTACT POSITIONS SPECIFIED ARE FOR NON-CONFLICT MODE. (2) TO PROGRAM MMU, SOLDER JUMPERS IN PROGRAMMING CARD FOR ALL PERMISSABLE PHASE MOVEMENTS, MINIMUM CHANGE DIS-ABLE FOR ALL PEDESTRIAN CHANNELS, AND MIN. FLASH, VOLTAGE MON., AND 24V. MON. LATCH OPTIONS AS DESIRED. M.M.U. CHANNEL ASSIGNMENTS <table><tr><td>CH. 1 =</td><td>L/S 1 =</td><td>^1 VEH.</td></tr><tr><td>CH. 2 =</td><td>L/S 2 =</td><td>^2 VEH.</td></tr><tr><td>CH. 3 =</td><td>L/S 3 =</td><td>^3 VEH.</td></tr><tr><td>CH. 4 =</td><td>L/S 4 =</td><td>^4 VEH.</td></tr><tr><td>CH. 5 =</td><td>L/S 5 =</td><td>^5 VEH.</td></tr><tr><td>CH. 6 =</td><td>L/S 6 =</td><td>^6 VEH.</td></tr><tr><td>CH. 7 =</td><td>L/S 7 =</td><td>^7 VEH.</td></tr><tr><td>CH. 8 =</td><td>L/S 8 =</td><td>^8 VEH.</td></tr><tr><td>CH. 9 =</td><td>L/S 9 =</td><td>^2 PED. / VEH. 1 FYA</td></tr><tr><td>CH. 10 =</td><td>L/S 10 =</td><td>^4 PED. / VEH. 3 FYA</td></tr><tr><td>CH. 11 =</td><td>L/S 11 =</td><td>^6 PED. / VEH. 5 FYA</td></tr><tr><td>CH. 12 =</td><td>L/S 12 =</td><td>^8 PED. / VEH. 7 FYA</td></tr><tr><td>CH. 13 =</td><td>L/S 13 =</td><td>O'LAP A VEH.</td></tr><tr><td>CH. 14 =</td><td>L/S 14 =</td><td>O'LAP B VEH.</td></tr><tr><td>CH. 15 =</td><td>L/S 15 =</td><td>O'LAP C VEH.</td></tr><tr><td>CH. 16 =</td><td>L/S 16 =</td><td>O'LAP D VEH.</td></tr></table>					CH. 1 =	L/S 1 =	^1 VEH.	CH. 2 =	L/S 2 =	^2 VEH.	CH. 3 =	L/S 3 =	^3 VEH.	CH. 4 =	L/S 4 =	^4 VEH.	CH. 5 =	L/S 5 =	^5 VEH.	CH. 6 =	L/S 6 =	^6 VEH.	CH. 7 =	L/S 7 =	^7 VEH.	CH. 8 =	L/S 8 =	^8 VEH.	CH. 9 =	L/S 9 =	^2 PED. / VEH. 1 FYA	CH. 10 =	L/S 10 =	^4 PED. / VEH. 3 FYA	CH. 11 =	L/S 11 =	^6 PED. / VEH. 5 FYA	CH. 12 =	L/S 12 =	^8 PED. / VEH. 7 FYA	CH. 13 =	L/S 13 =	O'LAP A VEH.	CH. 14 =	L/S 14 =	O'LAP B VEH.	CH. 15 =	L/S 15 =	O'LAP C VEH.	CH. 16 =	L/S 16 =	O'LAP D VEH.
CH. 1 =	L/S 1 =	^1 VEH.																																																							
CH. 2 =	L/S 2 =	^2 VEH.																																																							
CH. 3 =	L/S 3 =	^3 VEH.																																																							
CH. 4 =	L/S 4 =	^4 VEH.																																																							
CH. 5 =	L/S 5 =	^5 VEH.																																																							
CH. 6 =	L/S 6 =	^6 VEH.																																																							
CH. 7 =	L/S 7 =	^7 VEH.																																																							
CH. 8 =	L/S 8 =	^8 VEH.																																																							
CH. 9 =	L/S 9 =	^2 PED. / VEH. 1 FYA																																																							
CH. 10 =	L/S 10 =	^4 PED. / VEH. 3 FYA																																																							
CH. 11 =	L/S 11 =	^6 PED. / VEH. 5 FYA																																																							
CH. 12 =	L/S 12 =	^8 PED. / VEH. 7 FYA																																																							
CH. 13 =	L/S 13 =	O'LAP A VEH.																																																							
CH. 14 =	L/S 14 =	O'LAP B VEH.																																																							
CH. 15 =	L/S 15 =	O'LAP C VEH.																																																							
CH. 16 =	L/S 16 =	O'LAP D VEH.																																																							
f	A-29	CH. 6 YELLOW	6Y-A	^6 YEL																																																					
g	A-30	CH. 5 YELLOW	5Y-A	^5 YEL																																																					
h	A-31	CH. 3 YELLOW	3Y-A	^3 YEL																																																					
i	A-32	CH. 15 GREEN	15G-A	OLC GRN																																																					
j	A-33	CH. 2 YELLOW	2Y-A	^2 YEL																																																					
k	A-34	CH. 1 YELLOW	1Y-A	^1 YEL																																																					
m	A-35	CONT. VOLT. MON.	B-5	VOLT. MON.																																																					
n	A-36	+24V MON. INH.	B-2																																																						
p	A-37	OUT RLY 1 CLSD	J3-A3																																																						
q	A-38	OUT RLY 2 OPEN	A-31	STOP TIME																																																					
r	A-39	CH. 12 WALK	----																																																						
s	A-40	CH. 11 WALK	----																																																						
t	A-41	CH. 9 WALK	----																																																						
u	A-42	CH. 16 YELLOW	16Y-A	OLD YEL																																																					
v	A-43	CH. 15 YELLOW	15Y-A	OLC YEL																																																					
w	A-44	CH. 13 YELLOW	13Y-A	OLA YEL																																																					
x	A-45	CH. 4 YELLOW	4Y-A	^4 YEL																																																					
y	A-46	CH. 14 GREEN	14G-A	OLB GRN																																																					
z	A-47	CH. 13 GREEN	13G-A	OLA GRN																																																					
AA	A-48	(SPARE 1)	B24																																																						
BB	A-49	RESET	B-1																																																						
CC	A-50	CAB. INTLK A	B25																																																						
DD	A-51	CAB. INTLK B	B26																																																						
EE	A-52	CH. 14 YELLOW	14Y-A	OLB YRL																																																					
FF	A-53	CH. 16 GREEN	16G-A	OLD GRN																																																					
GG	A-54	(SPARE 2)	B27																																																						
HH	A-55	TYPE SELECT	A-20	MMU/CMU SEL.																																																					
	A-56	SHELL GND	LS15-2	EARTH GND.																																																					

MMU PROGRAM CARD

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16

2 3 4 5 6 7 8 9 10 11 12 13 14 15 16

3 4 5 6 7 8 9 10 11 12 13 14 15 16

4 5 6 7 8 9 10 11 12 13 14 15 16

5 6 7 8 9 10 11 12 13 14 15 16

6 7 8 9 10 11 12 13 14 15 16

7 8 9 10 11 12 13 14 15 16

8 9 10 11 12 13 14 15 16

9 10 11 12 13 14 15 16

10 11 12 13 14 15 16

11 12 13 14 15 16

12 13 14 15 16

13 14 15 16

14 15 16

15 16

RENO A&E

MIN YELLOW CHANGE DISABLE

1 2 3 4 5 6 7 8

9 10 11 12 13 14 15 16

MIN. FLASH TIME

8 4 2 1


24V LATCH ENA.

CVM LATCH ENA.


M.M.U. C/C'S AND PROGRAM CARD


DETECTOR RACK 34030G1 #1


B.I.U.	L3	L1	L7	L5	L11	L9	L15	L13	PMT 5	PMT 3	PGM. CARD
	5-1 ☐ 2CH	1-1 ☐ 2CH	6-1 ☐ 2CH	2-1 ☐ 2CH	7-1 ☐ 2CH	3-1 ☐ 2CH	☐ 2CH	☐ 2CH	☐ 2CH OPTICOM/OPIC CH. C CH. D	☐ 2CH OPTICOM/OPIC CH. A CH. B	
	5-2	1-2	6-2	2-2	7-2	3-2					
	L4	L2	L8	L6	L12	L10	L16	L14	PMT 6	PMT 4	

















DETECTOR ASSIGNMENTS		
CONT. INPUT	PHASE ASGN.	DETECTOR TYPE
1	1-1	1
2	1-2	1
3	5-1	1
4	5-2	1
5	2-1	1
6	2-2	1
7	6-1	1
8	6-2	1
9	3-1	1
10	3-2	1
11	7-1	1
12	7-2	1
13		
14		
15		
16		

RACK #1

DETECTOR RACK 34030G1 #2

B.I.U.	L3	L1	L7	L5	L11	L9	L15	L13	NOT USED	NOT USED	PGM. CARD
	4-1 ☐ 2CH	☐ 2CH	8-1 ☐ 2CH	☐ 2CH	☐ 2CH	☐ 2CH	☐ 2CH	☐ 2CH			
	4-2		8-2								
	L4	L2	L8	L6	L12	L10	L16	L14			

☒ J13
171-1676-515
DC POWER

☐ J16
C/C 33284G8
EXP. OUTPUTS

☒ J14
C/C 33284G2
LPS 1-8

☐ J18
C/C 33284G9
SYS. OUTPUTS

☒ J15
C/C 33284G3
LPS 9-16

☒ J17
171-1676-515
AC POWER

☐ J19
C/C 33284G17
PGM. CARD

DETECTOR ASSIGNMENTS		
CONT. INPUT	PHASE ASGN.	DETECTOR TYPE
17	4-1	1
18	4-2	1
19		
20		
21	8-1	1
22	8-2	1
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		



RACK #2

ADDRESS TABLE		
RACK #	JMPR	DET. #'S
1		1-16
2		17-32
3		33-48

DETECTOR RACK PROGRAMMING JUMPERS

DC POWER ①				CONFIGURATION SLOT 1/2 ④								CONFIGURATION SLOT 3/4 ④								CONFIGURATION SLOT 5/6 ④								CONFIGURATION SLOT 7/8 ④								DET. CMNS.
JP31	JP32	JP33	JP34	DET. TYPE	JP3	JP4	JP5	JP6	JP7	JP8	JP9	JP10	JP11	JP12	JP13	JP14	JP15	JP16	JP17	JP18	JP19	JP20	JP21	JP22	TP1	JP23	JP24	JP25	JP26	JP27	JP28	TP2	JP29	JP30	JP38—JP55	
				1	TS-1																															
				2	* TS-2																															
				3	LM-632T 262-FC																															
				4	MAG.																															
				5	LM-642() (TS-2)																															

- ① INSTALL JUMPERS ON JP31 THRU JP34 WHEN A SHELF MOUNT POWER SUPPLY IS USED. WARNING — DO NOT INSTALL JUMPERS WHEN A PLUG-IN POWER SUPPLY IS USED.
- ② INSTALL JUMPERS ON JP38 — JP55 WHEN PGM. CARD IS NOT USED.
- ③ PROGRAM CARD AND PLUG-IN POWER SUPPLY ARE FOR TS-1 APPLICATIONS ONLY. REMOVE FOR TS-2 APPLICATIONS.
- ④ PROGRAM JUMPERS USING CONFIGURATION NUMBER AS SHOWN BY ASTERISK.

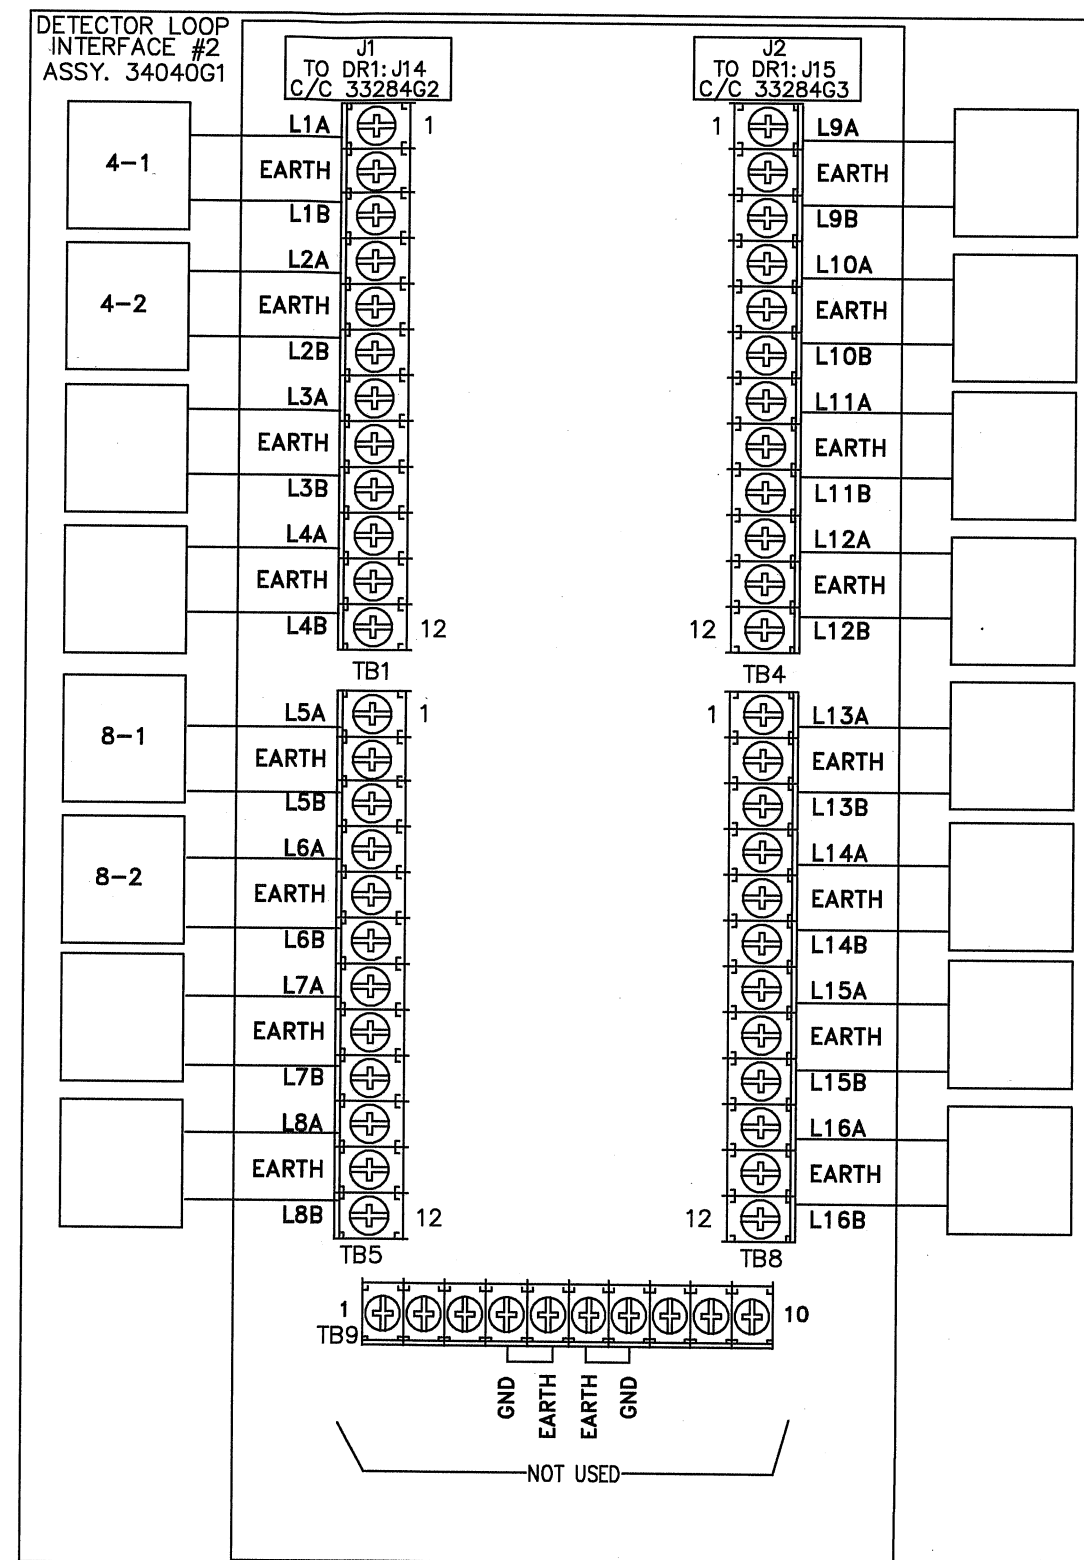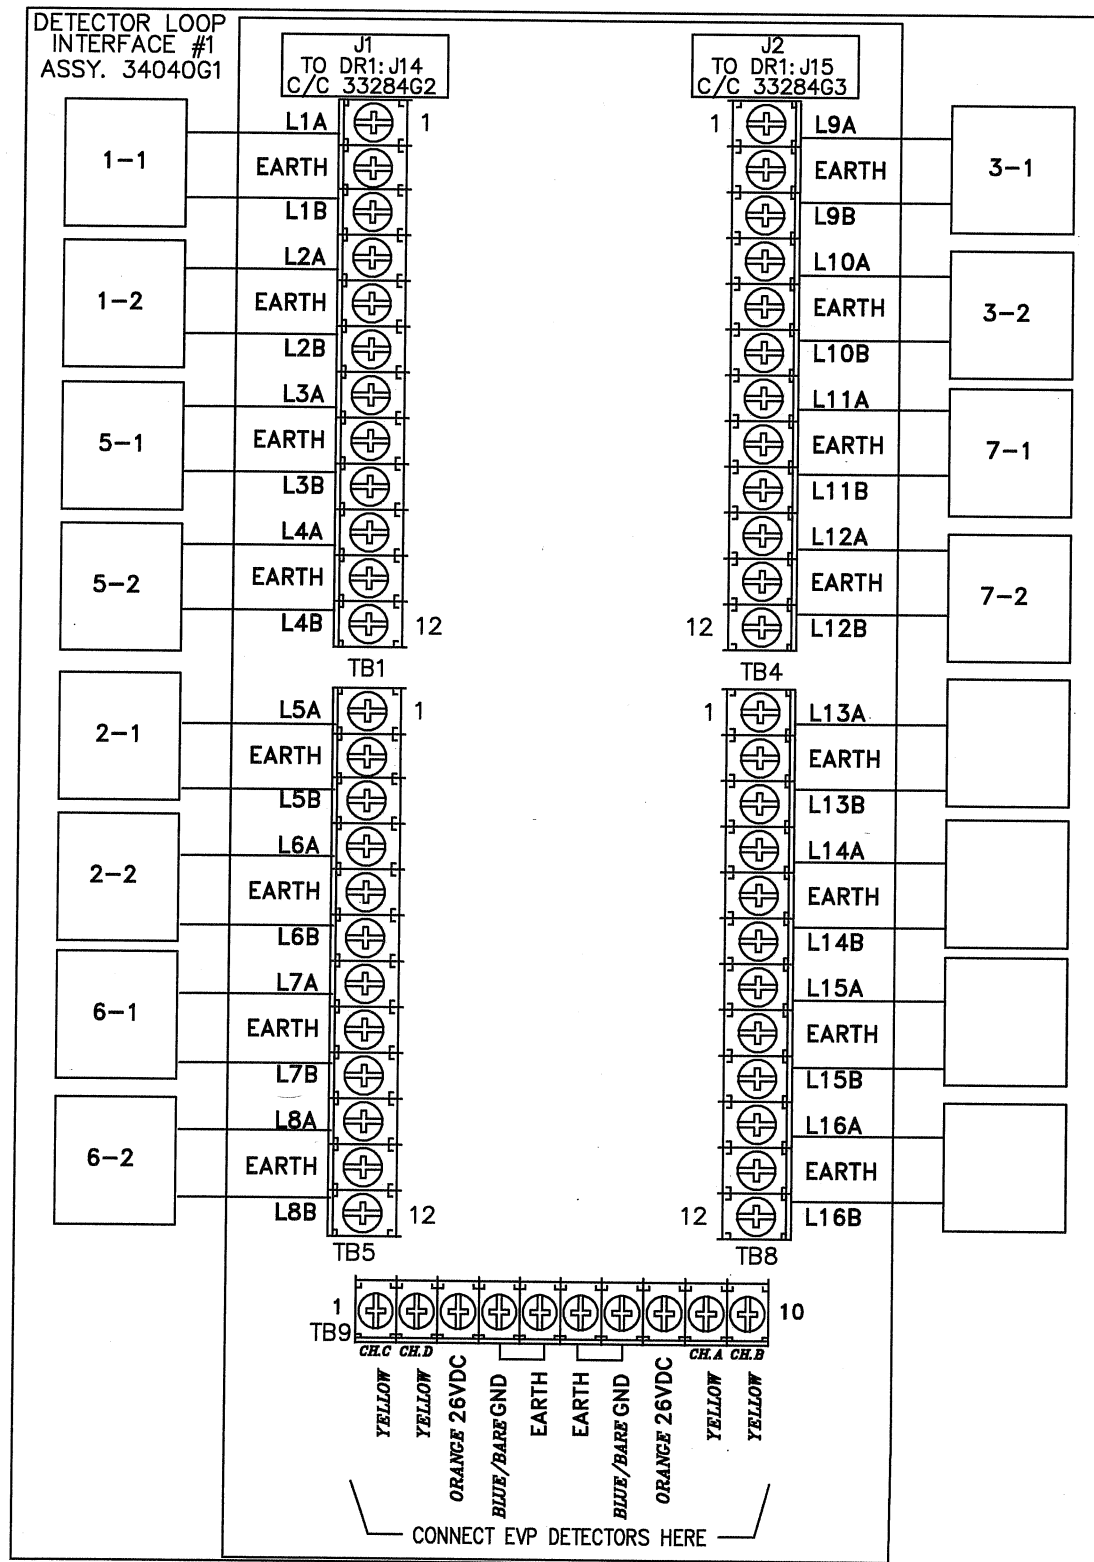

DET. LOOPS 1-8 (J14) C/C 33284G2		
PIN	SIGNAL	TO
1	LOOP 1+	LPI1: TB1-1
2	LOOP 1-	LPI1: TB1-3
3	LOOP 2+	LPI1: TB1-4
4	LOOP 2-	LPI1: TB1-6
5	LOOP 3+	LPI1: TB1-7
6	LOOP 3-	LPI1: TB1-9
7	LOOP 4+	LPI1: TB1-10
8	LOOP 4-	LPI1: TB1-12
9	LOOP 5+	LPI1: TB5-1
10	LOOP 5-	LPI1: TB5-3
11	LOOP 6+	LPI1: TB5-4
12	LOOP 6-	LPI1: TB5-6
13	LOOP 7+	LPI1: TB5-7
14	LOOP 7-	LPI1: TB5-9
15	LOOP 8+	LPI1: TB5-10
16	LOOP 8-	LPI1: TB5-12
17	PMT. DET. CH. C	LPI1: TB9-1
18	PMT. DET. CH. D	LPI1: TB9-2
19	KEY PIN	
20	PMT. CH. C/D +26VDC	LPI1: TB9-3
21	PMT. DC GROUND	LPI1: TB9-4,7
22	PMT. CH. A/B +26VDC	LPI1: TB9-8
23	PMT. DET. CH. A	LPI1: TB9-9
24	PMT. DET. CH. B	LPI1: TB9-10
25	---	
26	---	

DET. LOOPS 9-16 (J15) C/C 33284G3		
PIN	SIGNAL	TO
1	LOOP 9+	LPI2: TB4-1
2	LOOP 9-	LPI2: TB4-3
3	LOOP 10+	LPI2: TB4-4
4	LOOP 10-	LPI2: TB4-6
5	LOOP 11+	LPI2: TB4-7
6	LOOP 11-	LPI2: TB4-9
7	LOOP 12+	LPI2: TB4-10
8	LOOP 12-	LPI2: TB4-12
9	LOOP 13+	LPI2: TB8-1
10	LOOP 13-	LPI2: TB8-3
11	LOOP 14+	LPI2: TB8-4
12	LOOP 14-	LPI2: TB8-6
13	LOOP 15+	LPI2: TB8-7
14	LOOP 15-	LPI2: TB8-9
15	LOOP 16+	LPI2: TB8-10
16	LOOP 16-	LPI2: TB8-12
17	---	
18	---	
19	---	
20	---	

DET. RACK POWER 171-1676-515			
P1/ DR: J13	P2/ DR: J17	FUNCTION	TO
1		+12 VDC (DET. POWER)	PB-3
2		+24 VDC (BIU POWER)	PB-2
3		LOGIC GROUND	PB-1
4		EARTH GROUND	PB-9
5		"KEY PIN"	
6		LINE FREQUENCY REF.	PB-5
	1	EARTH GROUND	---
	2	AC LINE	PB-12
	3	AC NEUTRAL	PB-10
	4	LOGIC GROUND	---

EXPANSION OUTPUTS C/C 33284G84		
J16	FUNCTION	TO
17	DET. 17 / PMT. A OUT	MP: B19
18	DET. 18 / PMT. B OUT	MP: B20
19	PMT. C OUT	MP: B17
20	PMT. D OUT	MP: B18

RACK #1 ONLY

DETECTOR LOOP INTERFACE

B.I.U	DET	PH	F	DET	DLY	EXT	DET	PH	F	DET	DLY	EXT	DET	PH	F	DET	DLY	EXT	DET	PH	F	DET	DLY	EXT	EVP	PH	POLE #	CONT CH #	
	CH 1	1	1	1-1			CH 5	2	1	2-1			CH 9	3	1	3-1			CH 13						CH 1	1-6	3	3	
	CH 2	1	1	1-2			CH 6	2	1	2-2			CH 10	3	1	3-2	2.0		CH 14						CH 2	2-5	1	4	
	CH 3	5	1	5-1			CH 7	6	1	6-1			CH 11	7	1	7-1			CH 15						CH 3	3-8	4	5	
	CH 4	5	1	5-2			CH 8	6	1	6-2			CH 12	7	1	7-2	2.0		CH 16						CH 4	4-7	2	6	
B.I.U	DET	PH	F	DET	DLY	EXT	DET	PH	F	DET	DLY	EXT	DET	PH	F	DET	DLY	EXT	DET	PH	F	DET	DLY	EXT					
	CH 17	4	3/8	4-1			CH 21	8	3/8	8-1			CH 25						CH 29										
	CH 18	4	7	4-2	5.0		CH 22	8	7	8-2	10.0		CH 26						CH 30										
	CH 19						CH 23						CH 27						CH 31										
	CH 20						CH 24						CH 28						CH 32										

EVP SENSORS						
CABLE	DISCR.	PHASES	POLE#	TERMINAL TB9		
	CHAN.			SIGNAL	DC(+)	GND
28	1	1-6	3	A	26+	GND
55	2	2-5	1	B	26+	GND
65	3	3-8	4	C	26+	GND
18,64	4	4-7	2	D	26+	GND

EVP VERIFY LIGHTS				
CABLE	CONTR	PHASES	POLE#	TERM.
	CHAN.			
27	3	1-6	3	59
56	4	2-5	1	65
66	5	3-8	4	71
17	6	4-7	2	77

CABLE	SIGNAL	TERMINAL						
		G	FLA	Y	R	G	Y	R
19	1-1	1	3	5	7			
11	1-2	2	4	6	8			
50,52	2-1,2-3					9	11	13
51	2-2					10	12	14
57	3-1	15	17	19	21			
20	3-2	16	18	20	22			
13	4-1					23	25	27
14	4-2					24	26	28
47	5-1	29	31	33	35			
58	5-2	30	32	34	36			
22,24	6-1,6-3					37	39	41
23	6-2					38	40	42
10	7-1	43	45	47	49			
48	7-2	44	46	48	50			
60	8-1					51	53	55
61	8-2					52	54	56

CABLE	DET	SLOT	FUNC	RACK	TERMINAL
71	1-1	1	1	1	L1
72	1-2	2	1	1	L2
37	2-1	5	1	1	L5
38	2-2	6	1	1	L6
32	3-1	9	1	1	L9
33	3-2	10	1	1	L10
46	4-1	17	3/8	2	L1
43	4-2	18	7	2	L2
39	5-1	3	1	1	L3
40	5-2	4	1	1	L4
69	6-1	7	1	1	L7
70	6-2	8	1	1	L8
44	7-1	11	1	1	L11
45	7-2	12	1	1	L12
34	8-1	21	3/8	2	L5
31	8-2	22	7	2	L6

PED PUSHBUTTONS			
CABLE	PPB	TERMINAL	RETURN
35	2-1	801	GB1
30	2-2	801	GB1
41	4-1	802	GB1
36	4-2	802	GB1
74	6-1	803	GB1
42	6-2	803	GB1
68	8-1	804	GB1
73	8-2	804	GB1

CABLE	SIGNAL	TERMINAL	
		WK	DW
15	2-1	57	61
53	2-2	58	62
25	4-1	63	67
16	4-2	64	68
63	6-1	69	73
26	6-2	70	74
54	8-1	75	79
62	8-2	76	80